

BRICK SLIP OUTER LEAF BUILD-UP (TO PROVIDE 0.17W/m²K U-VALUE):

- 60mm GEBRIK BRICK SLIPS WITH POLYISOCYANURATE FOAM
- 90mm KINGSPAN KOOLTHERM K12 INSULATION
- 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
- 30mm CAVITY
- BREATHER MEMBRANE
- 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
- 150mm LIGHT STEEL FRAME SYSTEM WITH 150mm MINERAL WOOL INSULATION (0.038 THERMAL CONDUCTIVITY)
- VCL
- 15mm FIRELINE PLASTERBOARD
- 12.5mm PLASTERBOARD - ALL JOINTS TO BE TAPED AND SEALED. SEAL ALL JUNCTIONS WITH INTUMESCENT SEALANT

SKIRTING 25x100mm PENCIL ROUNDED PAINTED MDF

1.2mm X 200mm STEEL PLATE FIXED TO STUDS WITH NOMINAL 45mm PERIMETER INSULATION

FLOOR BUILD-UP (TO PROVIDE 0.11W/m²K U-VALUE):

- BEAM AND BLOCK FLOORING TO SE'S DESIGN AND SPECIFICATION
- 1200 GAUGE DPM TO OVERLAP WITH DPC
- 2 LAYERS 75mm INSULATION KINGSPAN KOOLTHERM K103
- 65mm CONCRETE ON SEPARATING LAYER TO SE'S DESIGN AND SPECIFICATION

PPC FLASHING

DPC

TELESCOPIC VENT

RiW SHEETSEAL 226 (300mm) MIN. 100mm OVERLAP TO DPC AT BOTTOM & AT TOP WITH BREATHER MEMBRANE. MECHANICAL FIXINGS PER RiW REQUIREMENTS

INSULATION TO OVERLAP A MINIMUM OF 75mm WITH THE 30mm PERIMETER INSULATION

DPC WRAPPED ROUND BB FLOOR AND LEAN MIX

FOUNDATION TO SE'S DESIGN AND SPECIFICATIONS

100mm CONCRETE OVERSITE

Rev.	Date	Description	Init.
B	26/01/2017	General Build up Amendments	CM
A	13/10/2016	General Build up Amendments	EHG/DW

Client
HADFRAME


Project Title
HADFRAME SYSTEM

Drawing Title
3B5P EXTERNAL WALL AND GROUND FLOOR JUNCTION INSULATED BRICK SLIPS

Cad File	Sheet Size	Scale
1485_DETAILS SET A	A3	1:5
Drawn by	Drawing Date	Approved by
EHG	AUG 2016	DW
Project No.	Drawing No.	Revision
1485	D01A-3	B

This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

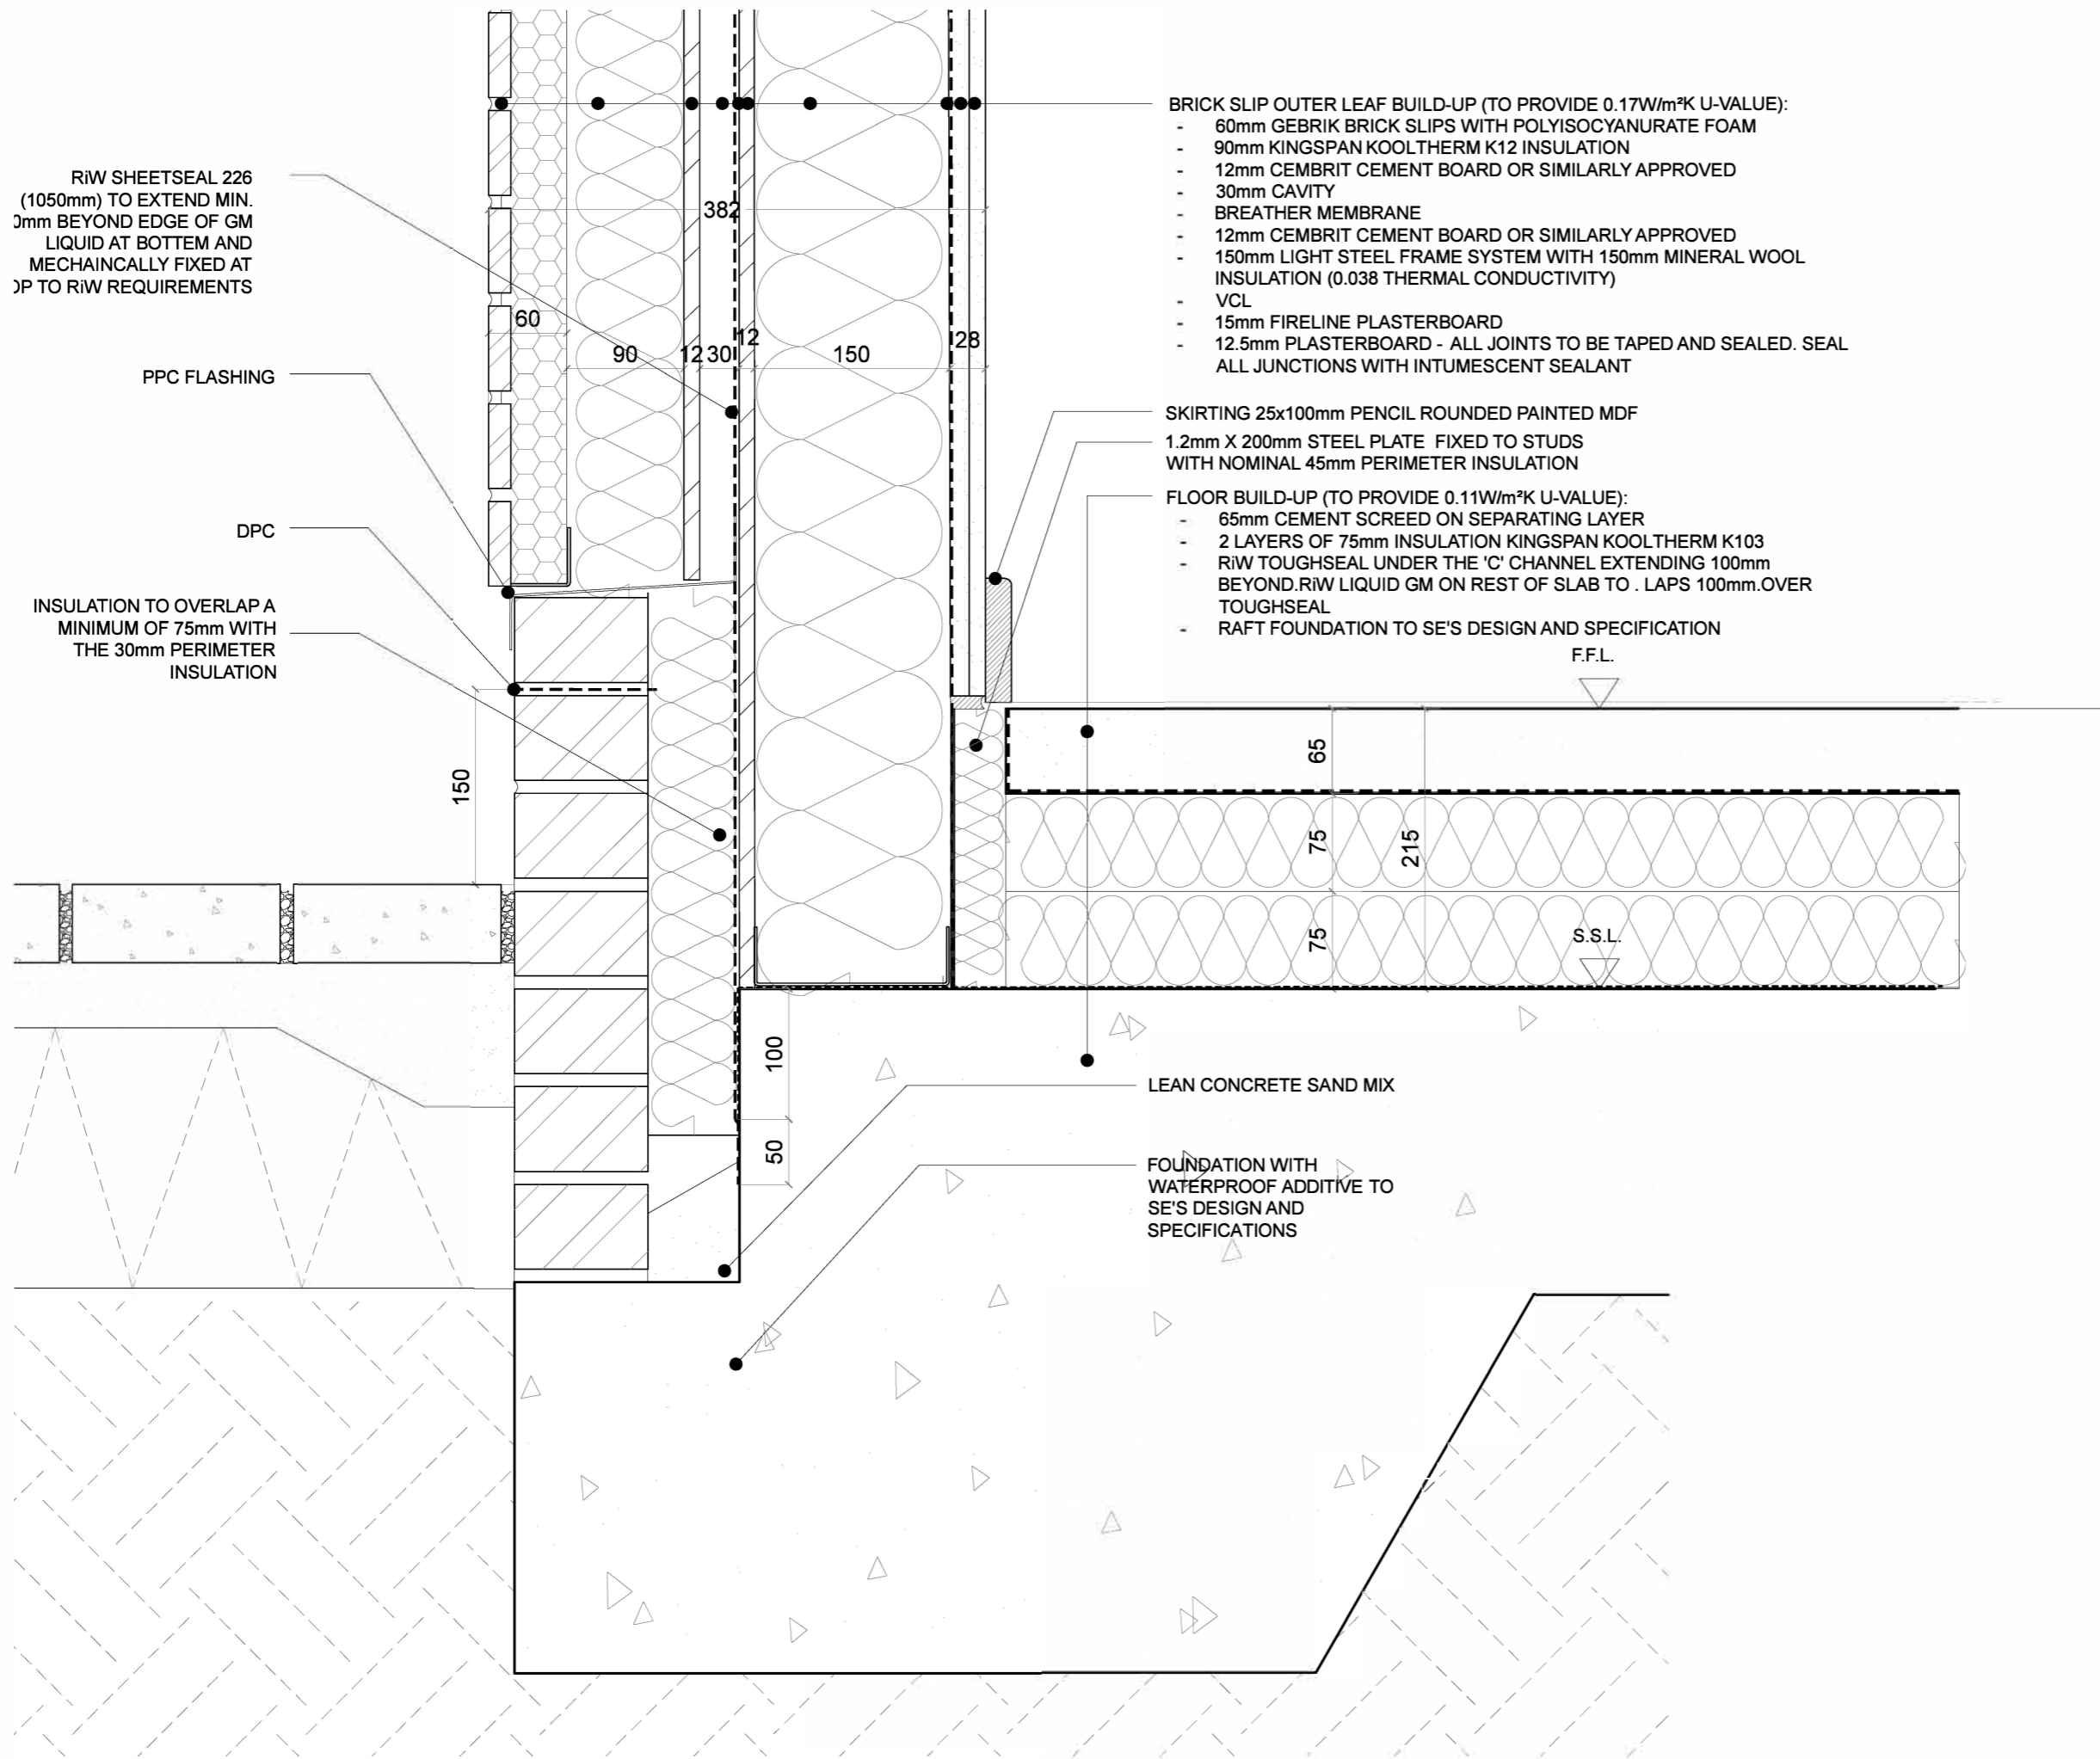

BRICK SLIP OUTER LEAF BUILD-UP (TO PROVIDE 0.17W/m²K U-VALUE):

- 60mm GEBRIK BRICK SLIPS WITH POLYISOCYANURATE FOAM
- 90mm KINGSPAN KOOLTHERM K12 INSULATION
- 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
- 30mm CAVITY
- BREATHER MEMBRANE
- 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
- 150mm LIGHT STEEL FRAME SYSTEM WITH 150mm MINERAL WOOL INSULATION (0.038 THERMAL CONDUCTIVITY)
- VCL
- 15mm FIRELINE PLASTERBOARD
- 12.5mm PLASTERBOARD - ALL JOINTS TO BE TAPED AND SEALED. SEAL ALL JUNCTIONS WITH INTUMESCENT SEALANT

SKIRTING 25x100mm PENCIL ROUNDED PAINTED MDF
1.2mm X 200mm STEEL PLATE FIXED TO STUDS WITH NOMINAL 45mm PERIMETER INSULATION

FLOOR BUILD-UP (TO PROVIDE 0.11W/m²K U-VALUE):

- 65mm CEMENT SCREED ON SEPARATING LAYER
- 2 LAYERS OF 75mm INSULATION KINGSPAN KOOLTHERM K103
- RiW TOUGHSEAL UNDER THE 'C' CHANNEL EXTENDING 100mm BEYOND RiW LIQUID GM ON REST OF SLAB TO LAPS 100mm.OVER TOUGHSEAL
- RAFT FOUNDATION TO SE'S DESIGN AND SPECIFICATION

RiW SHEETSEAL 226 (1050mm) TO EXTEND MIN. 30mm BEYOND EDGE OF GM LIQUID AT BOTTEM AND MECHAINCALLY FIXED AT OP TO RiW REQUIREMENTS

PPC FLASHING

DPC

INSULATION TO OVERLAP A MINIMUM OF 75mm WITH THE 30mm PERIMETER INSULATION

LEAN CONCRETE SAND MIX

FOUNDATION WITH WATERPROOF ADDITIVE TO SE'S DESIGN AND SPECIFICATIONS

Rev.	Date	Description	Init.
B	26/01/2017	General Build up Amendments	CM
A	05/09/2015	General Build up Amendments	EHG

Client

HADFRAME

Project Title

HADFRAME SYSTEM

Drawing Title

3B5P
EXTERNAL WALL AND RAFT JUNCTION
INSULATED BRICK SLIPS

Cad File Sheet Size Scale

1485_DETAILS SET A A3 1:5

Drawn by Drawing Date Approved by


EHG AUG 2016 DW

Project No. Drawing No. Revision

1485 D01A-8 B

This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

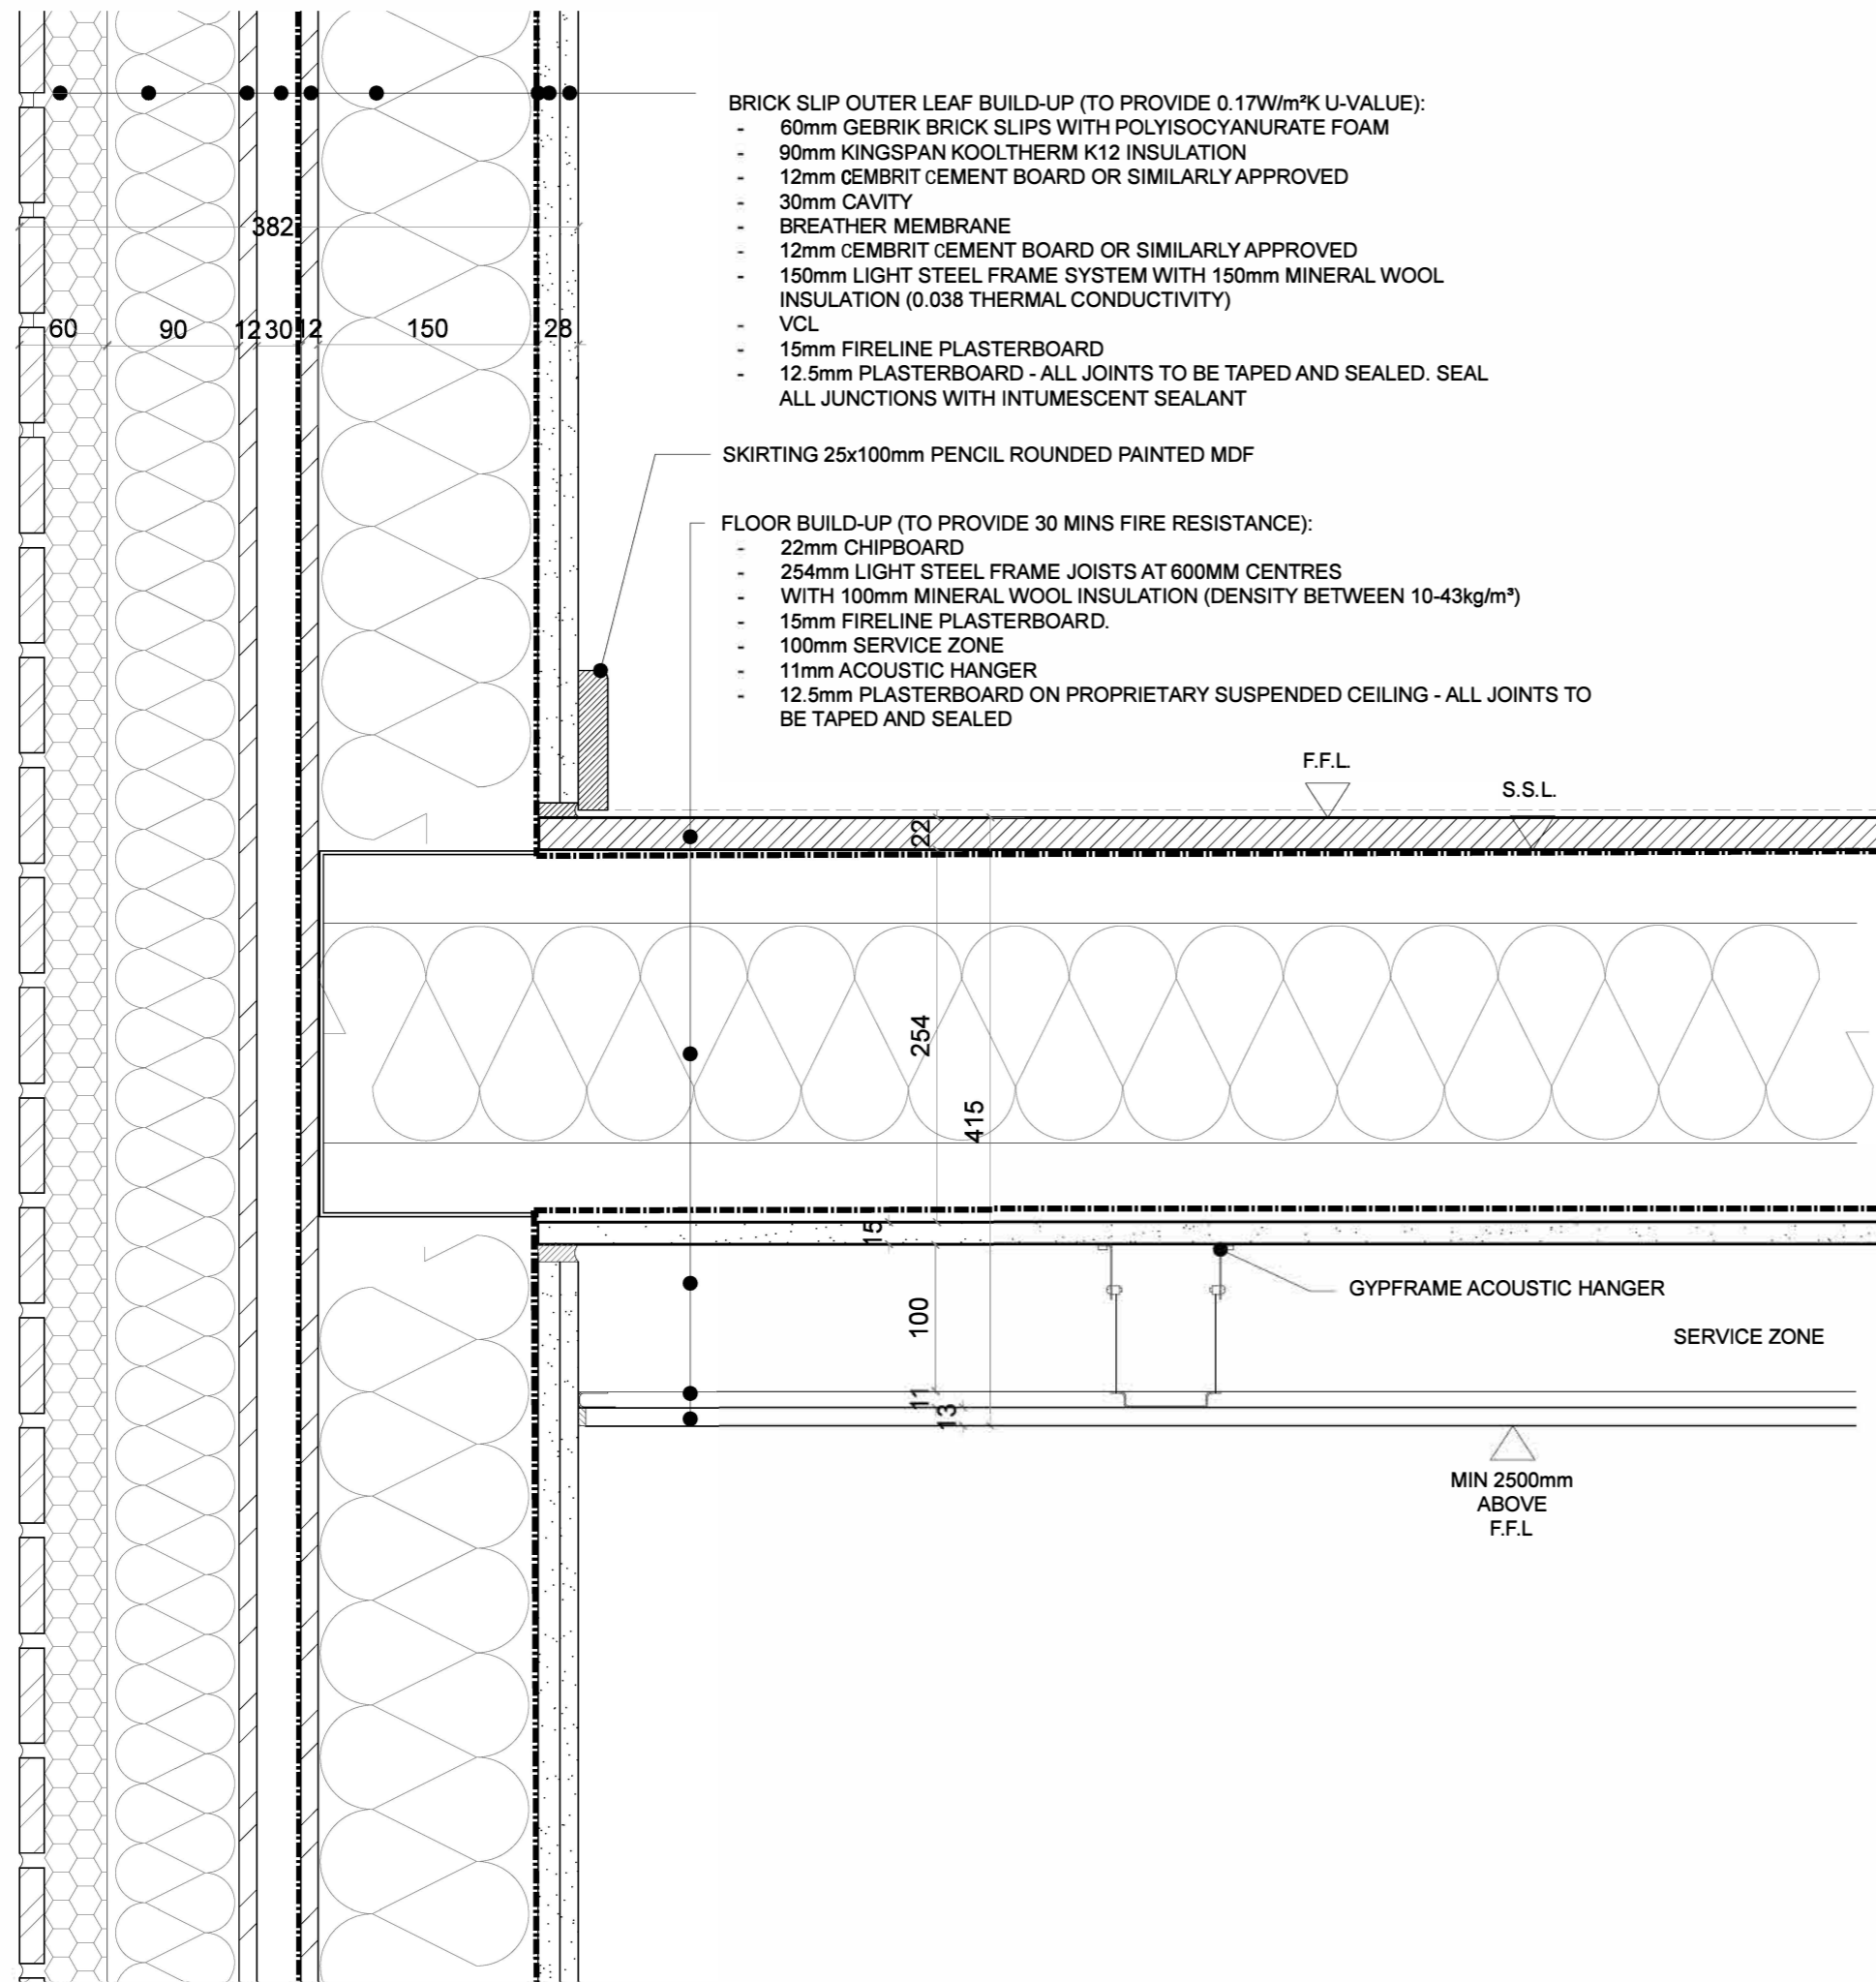

Rev.	Date	Description	Init.
B	26/01/2017	General Build up Amendments	CM
A	13/10/2016	General Build up Amendments	EHG/DW

Client

HADFRAME


Project Title

HADFRAME SYSTEM

Drawing Title
3B5P

**EXTERNAL WALL AND FIRST FLOOR JUNCTION
INSULATED BRICK SLIPS**

Cad File	Sheet Size	Scale
1485_DETAILS SET A	A3	1:5
Drawn by	Drawing Date	Approved by
EHG	AUG 2016	DW
Project No.	Drawing No.	Revision
1485	D02A-3	B

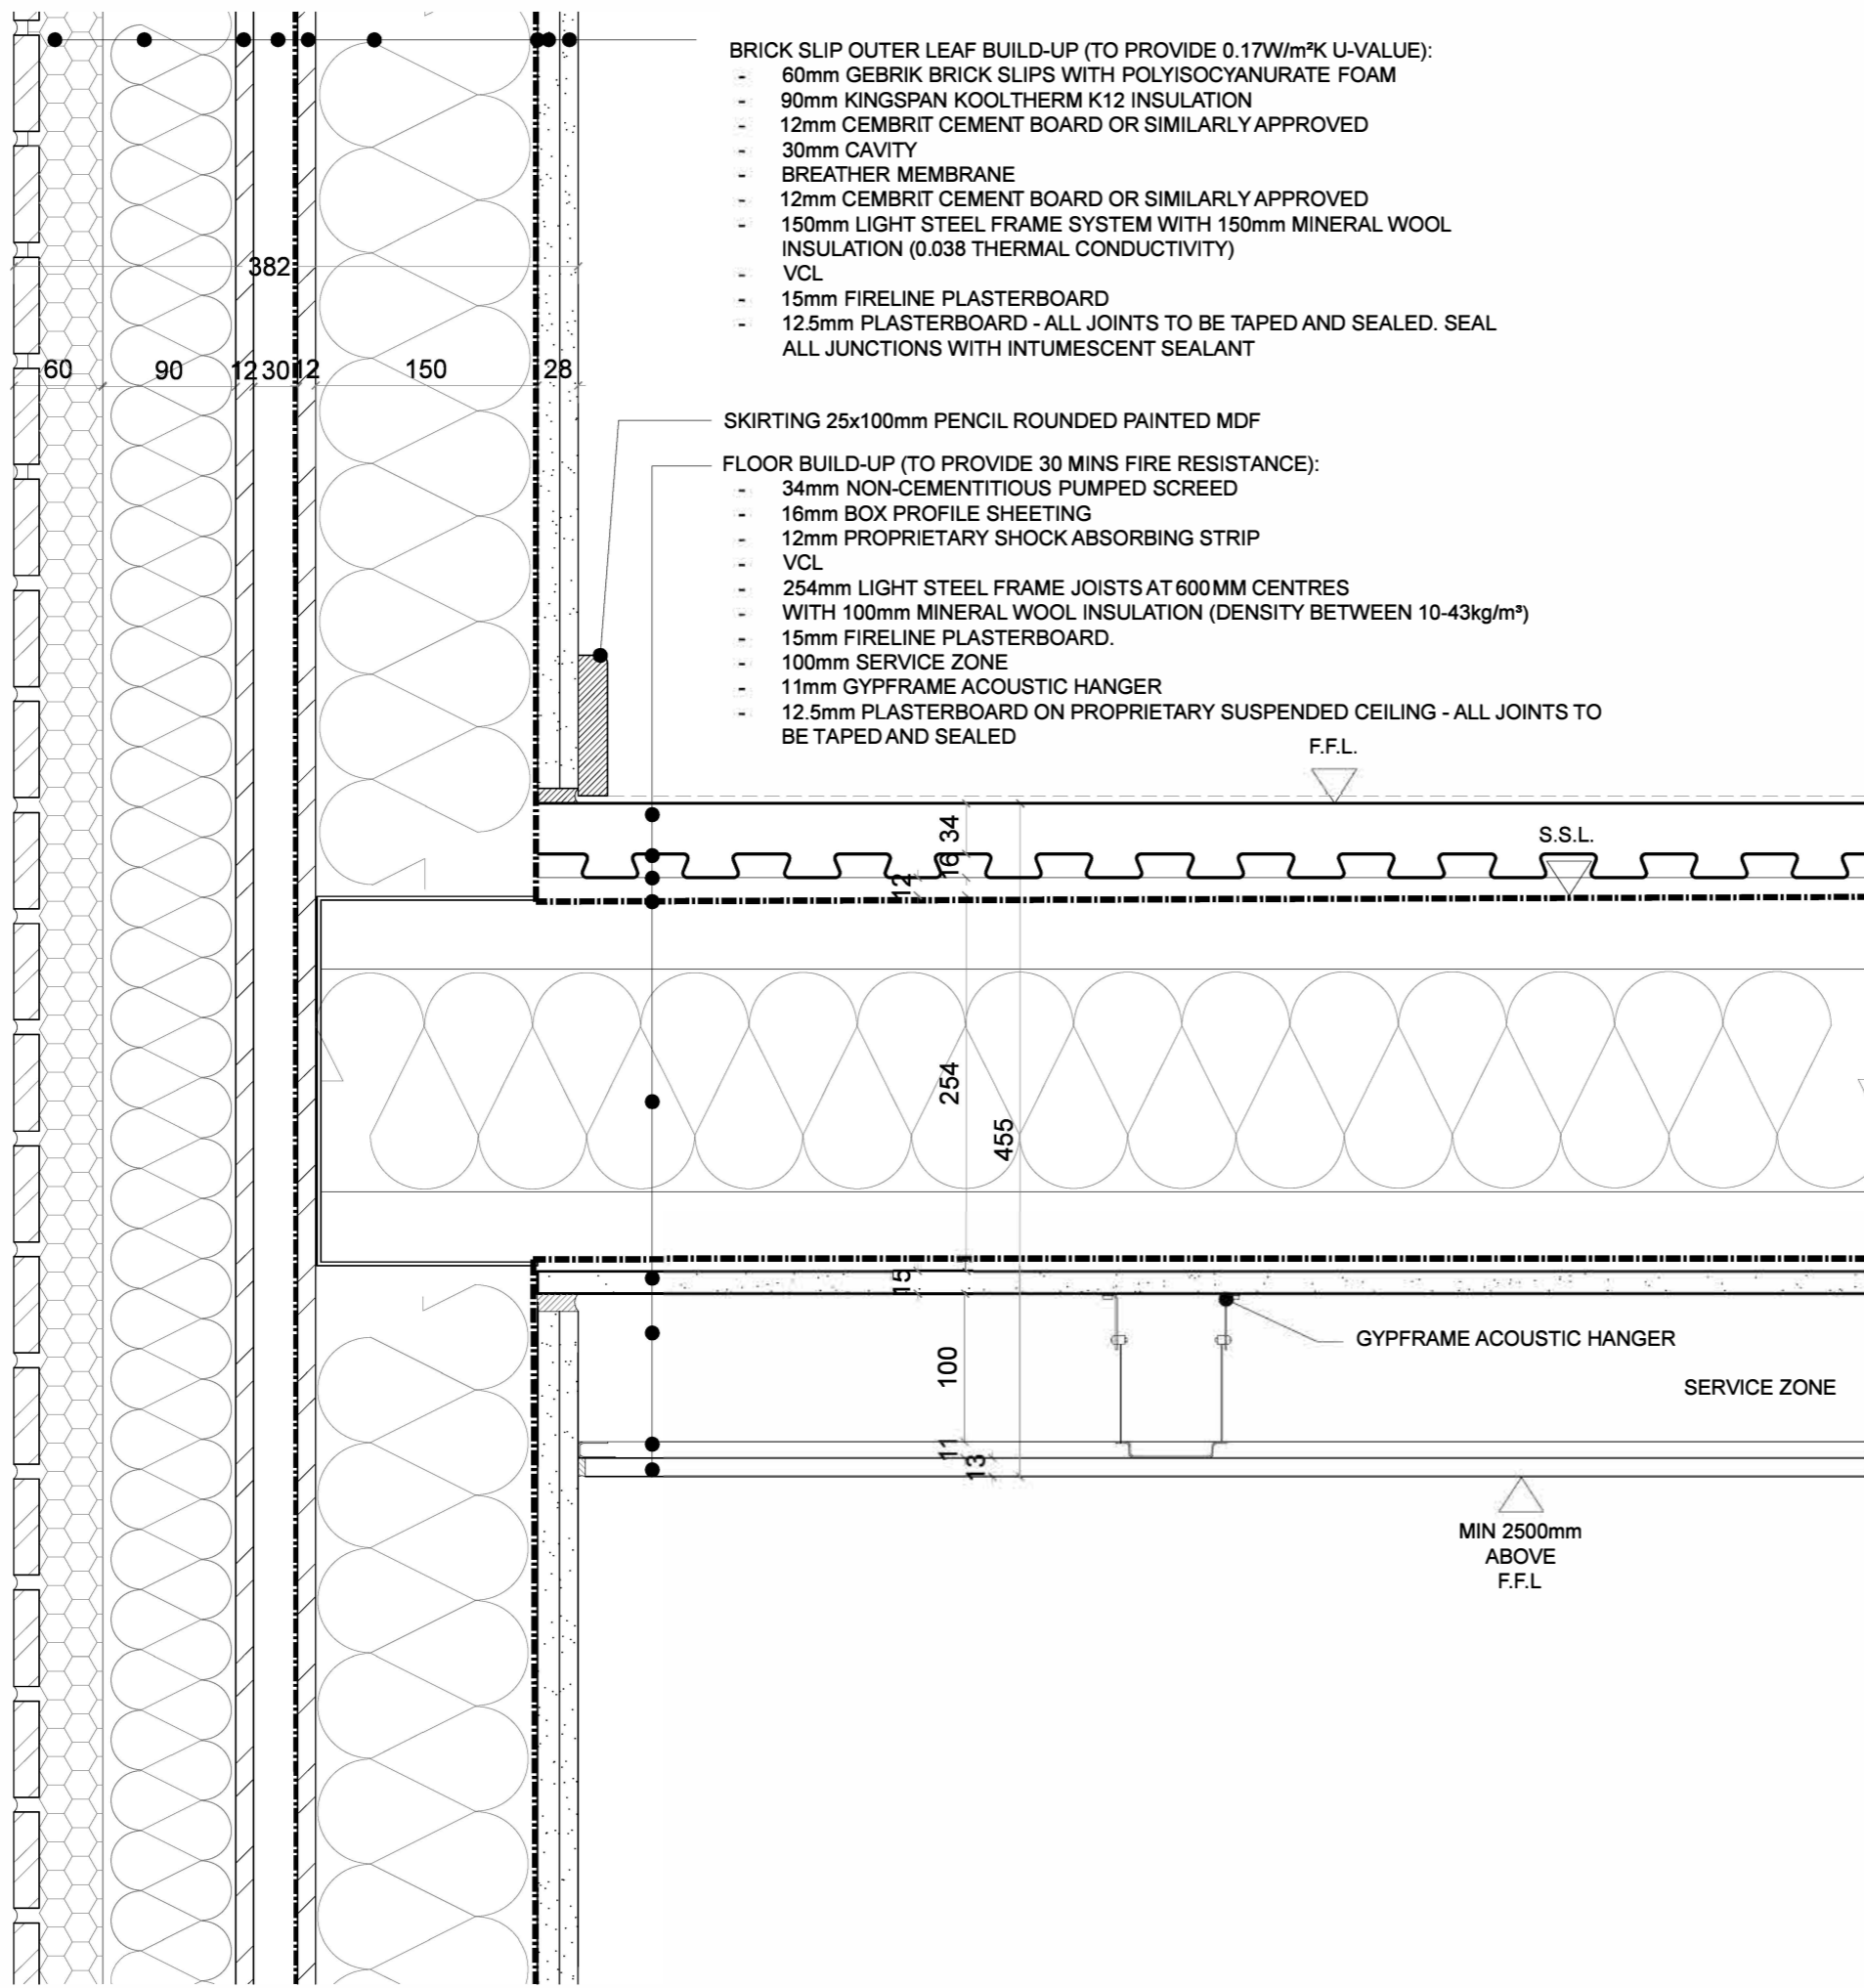

- BRICK SLIP OUTER LEAF BUILD-UP (TO PROVIDE 0.17W/m²K U-VALUE):
- 60mm GEBRIK BRICK SLIPS WITH POLYISOCYANURATE FOAM
 - 90mm KINGSPAN KOOLTHERM K12 INSULATION
 - 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
 - 30mm CAVITY
 - BREATHER MEMBRANE
 - 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
 - 150mm LIGHT STEEL FRAME SYSTEM WITH 150mm MINERAL WOOL INSULATION (0.038 THERMAL CONDUCTIVITY)
 - VCL
 - 15mm FIRELINE PLASTERBOARD
 - 12.5mm PLASTERBOARD - ALL JOINTS TO BE TAPED AND SEALED. SEAL ALL JUNCTIONS WITH INTUMESCENT SEALANT

- SKIRTING 25x100mm PENCIL ROUNDED PAINTED MDF
- FLOOR BUILD-UP (TO PROVIDE 30 MINS FIRE RESISTANCE):
- 34mm NON-CEMENTITIOUS PUMPED SCREED
 - 16mm BOX PROFILE SHEETING
 - 12mm PROPRIETARY SHOCK ABSORBING STRIP
 - VCL
 - 254mm LIGHT STEEL FRAME JOISTS AT 600MM CENTRES WITH 100mm MINERAL WOOL INSULATION (DENSITY BETWEEN 10-43kg/m³)
 - 15mm FIRELINE PLASTERBOARD.
 - 100mm SERVICE ZONE
 - 11mm GYPFRAME ACOUSTIC HANGER
 - 12.5mm PLASTERBOARD ON PROPRIETARY SUSPENDED CEILING - ALL JOINTS TO BE TAPED AND SEALED

Rev.	Date	Description	Init.
-	-	-	-

Client

HADFRAME

Project Title

HADFRAME SYSTEM

Drawing Title

3B5P
EXTERNAL WALL AND FIRST FLOOR JUNCTION
INSULATED BRICK SLIP

Cad File	Sheet Size	Scale
1485_DETAILS SET A	A3	1:5


Drawn by	Drawing Date	Approved by
AM	AUG 2016	DW

Project No.	Drawing No.	Revision
1485	D02A-8	-

1485 D02A-8

This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

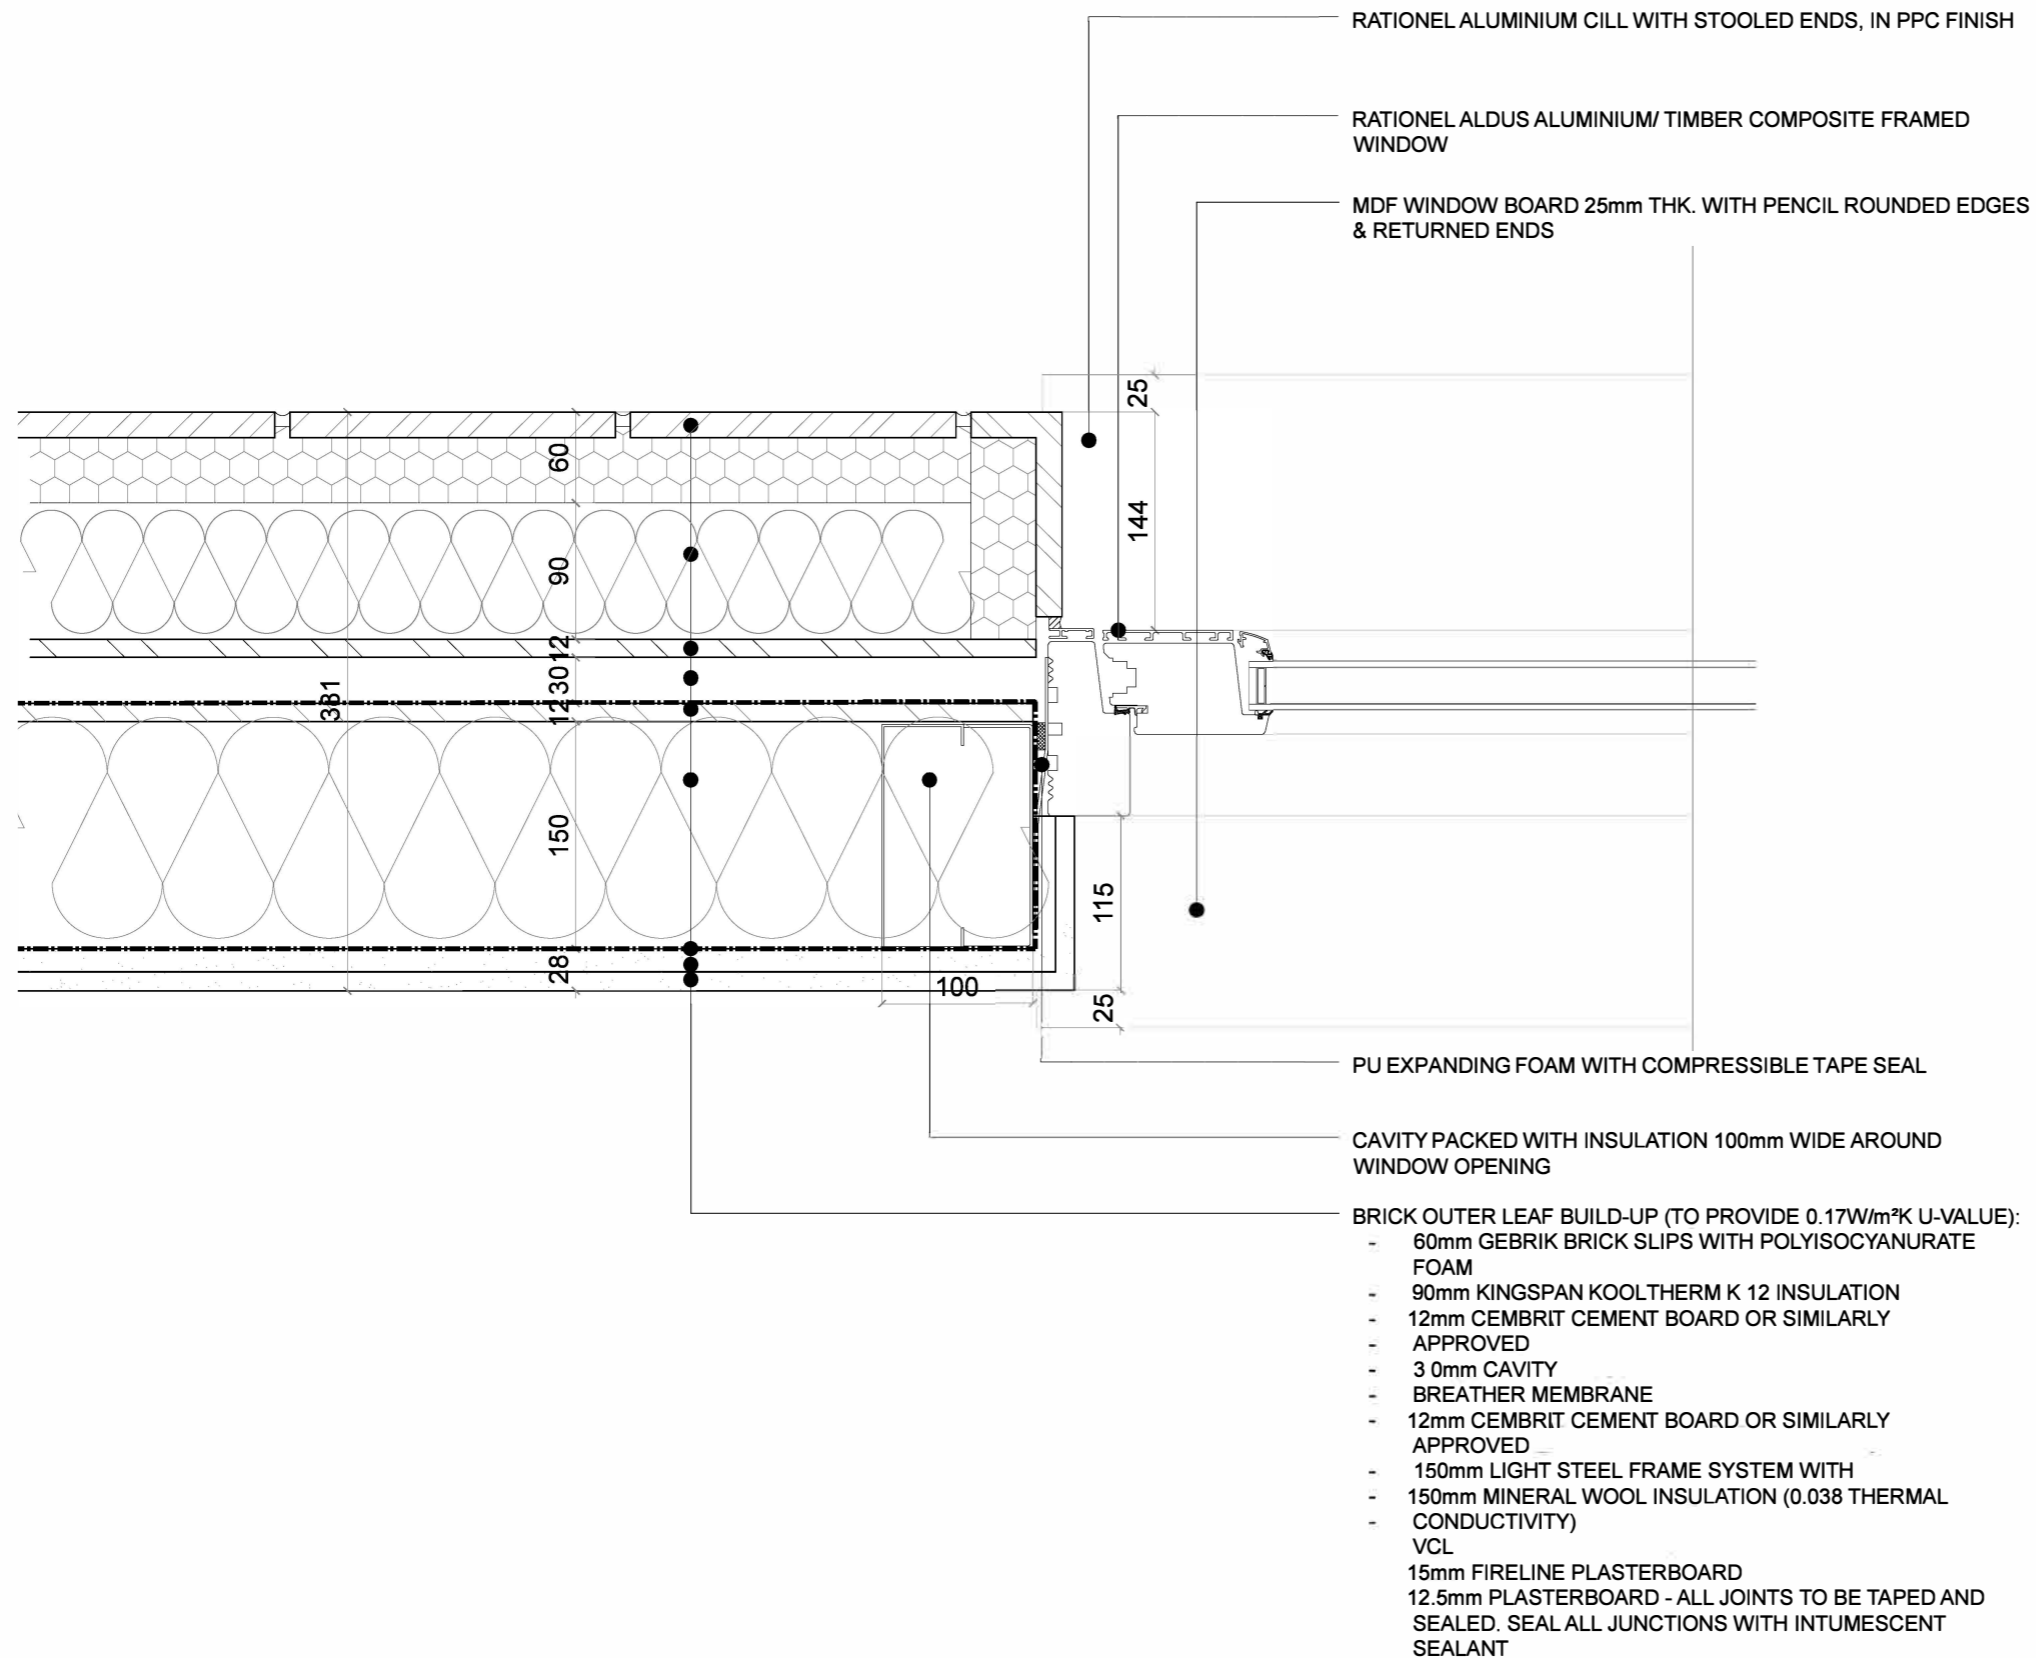

Rev.	Date	Description	Init.
B	26/01/2017	General Build up Amendments	CM
A	13/10/2016	General Build up Amendments	EHG/DW

Client

HADFRAME

Project Title

HADFRAME SYSTEM


Drawing Title

3B5P
WINDOW JAMB DETAIL
INSULATED BRICK SLIPS

Cad File	Sheet Size	Scale
1485_DETAILS SET A3	A3	1:5
Drawn by	Drawing Date	Approved by
EHG	AUG 2016	DW
Project No.	Drawing No.	Revision
1485	D04A-9	B

This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

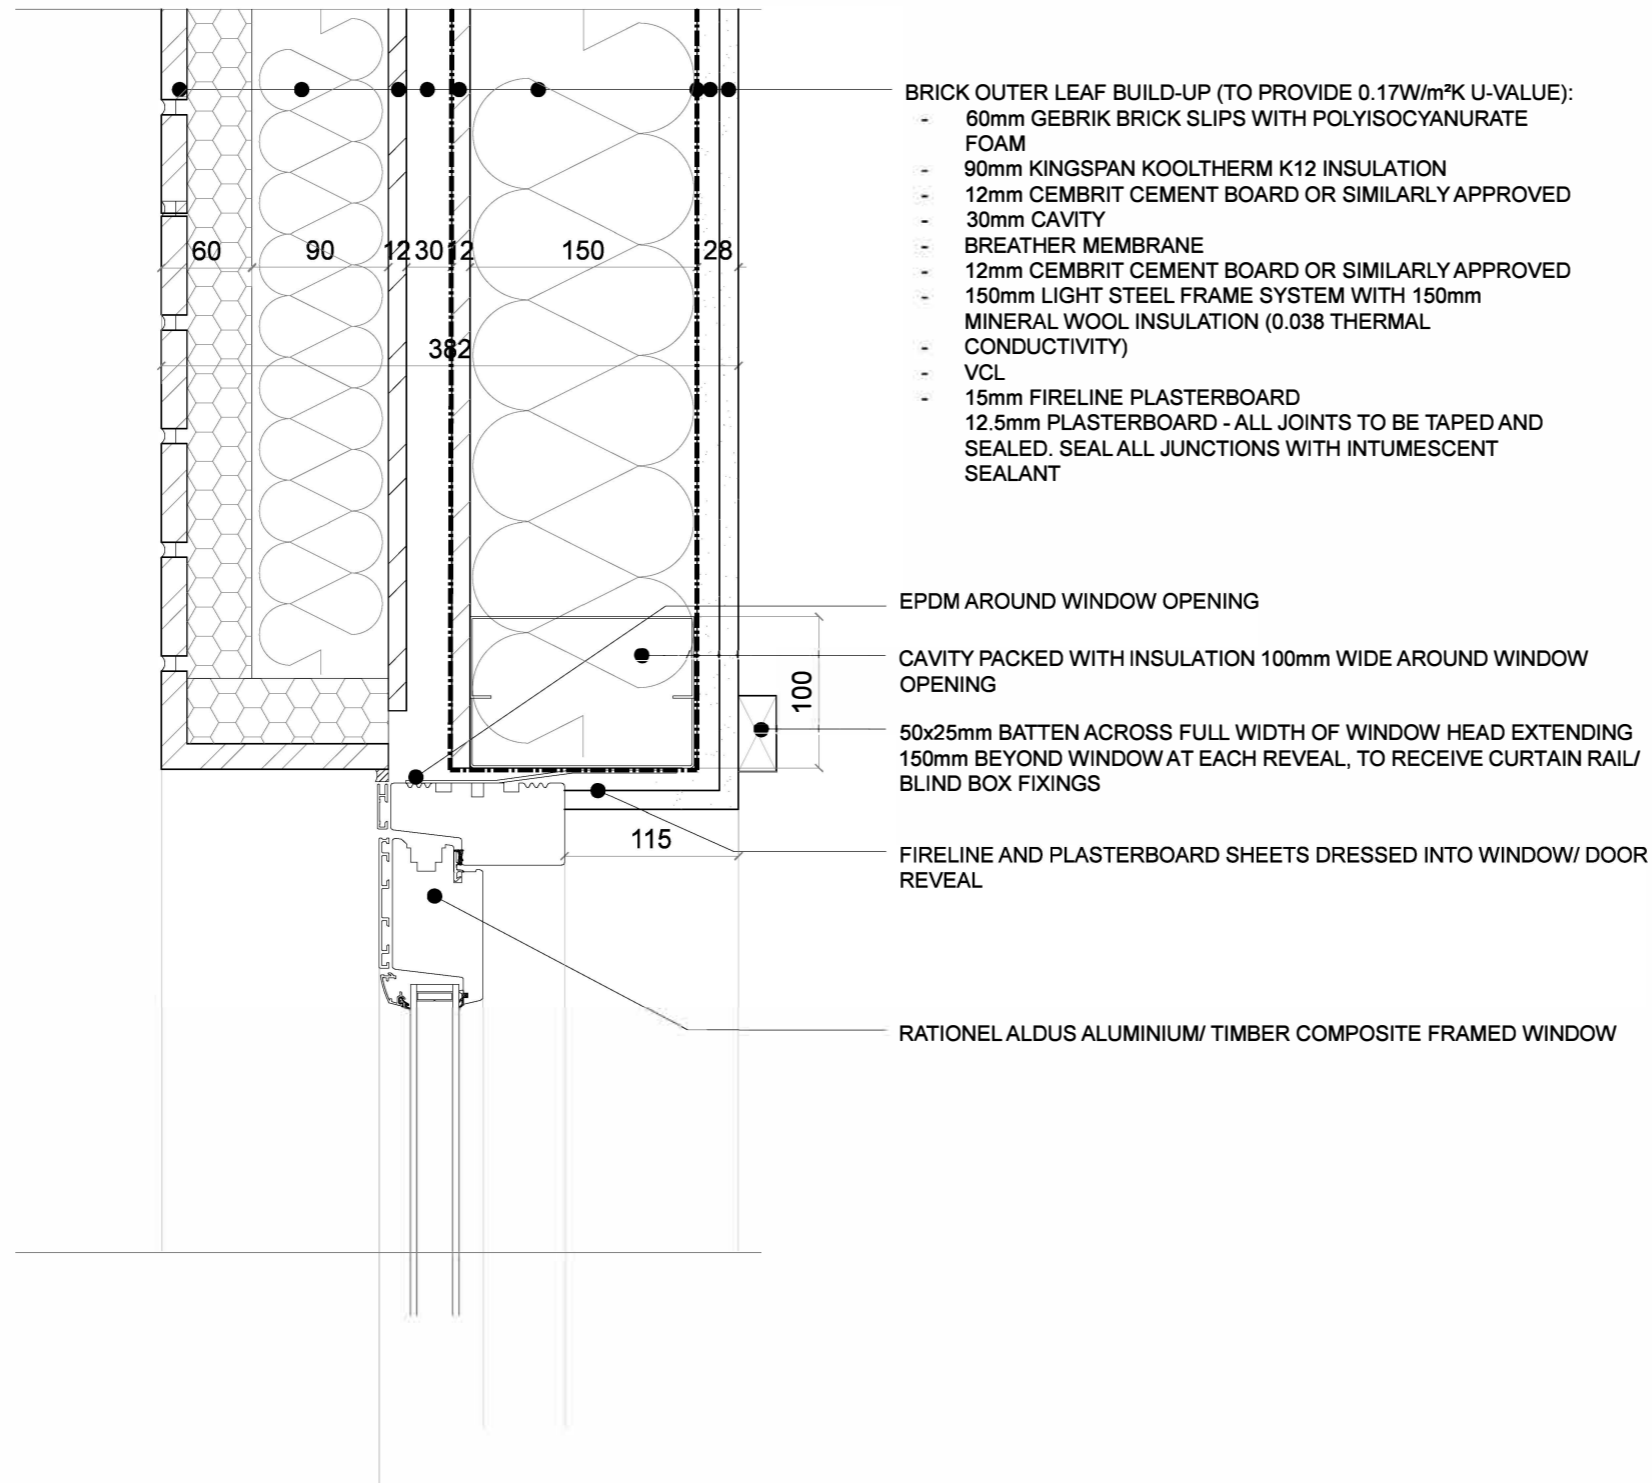


Rev.	Date	Description	Init.
B	26/01/2017	General Build up Amendments	CM
A	13/10/2016	General Build up Amendments	EHG/DW

Client		
HADFRAME		
Project Title		
HADFRAME SYSTEM		
Drawing Title		
3B5P		
WINDOW HEAD DETAIL		
INSULATED BRICK SLIPS		
Cad File	Sheet Size	Scale
1485_DETAILS SET A3	A3	1:5
Drawn by	Drawing Date	Approved by
EHG	AUG 2016	DW
Project No.	Drawing No.	Revision
1485	D04A-10	B

This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

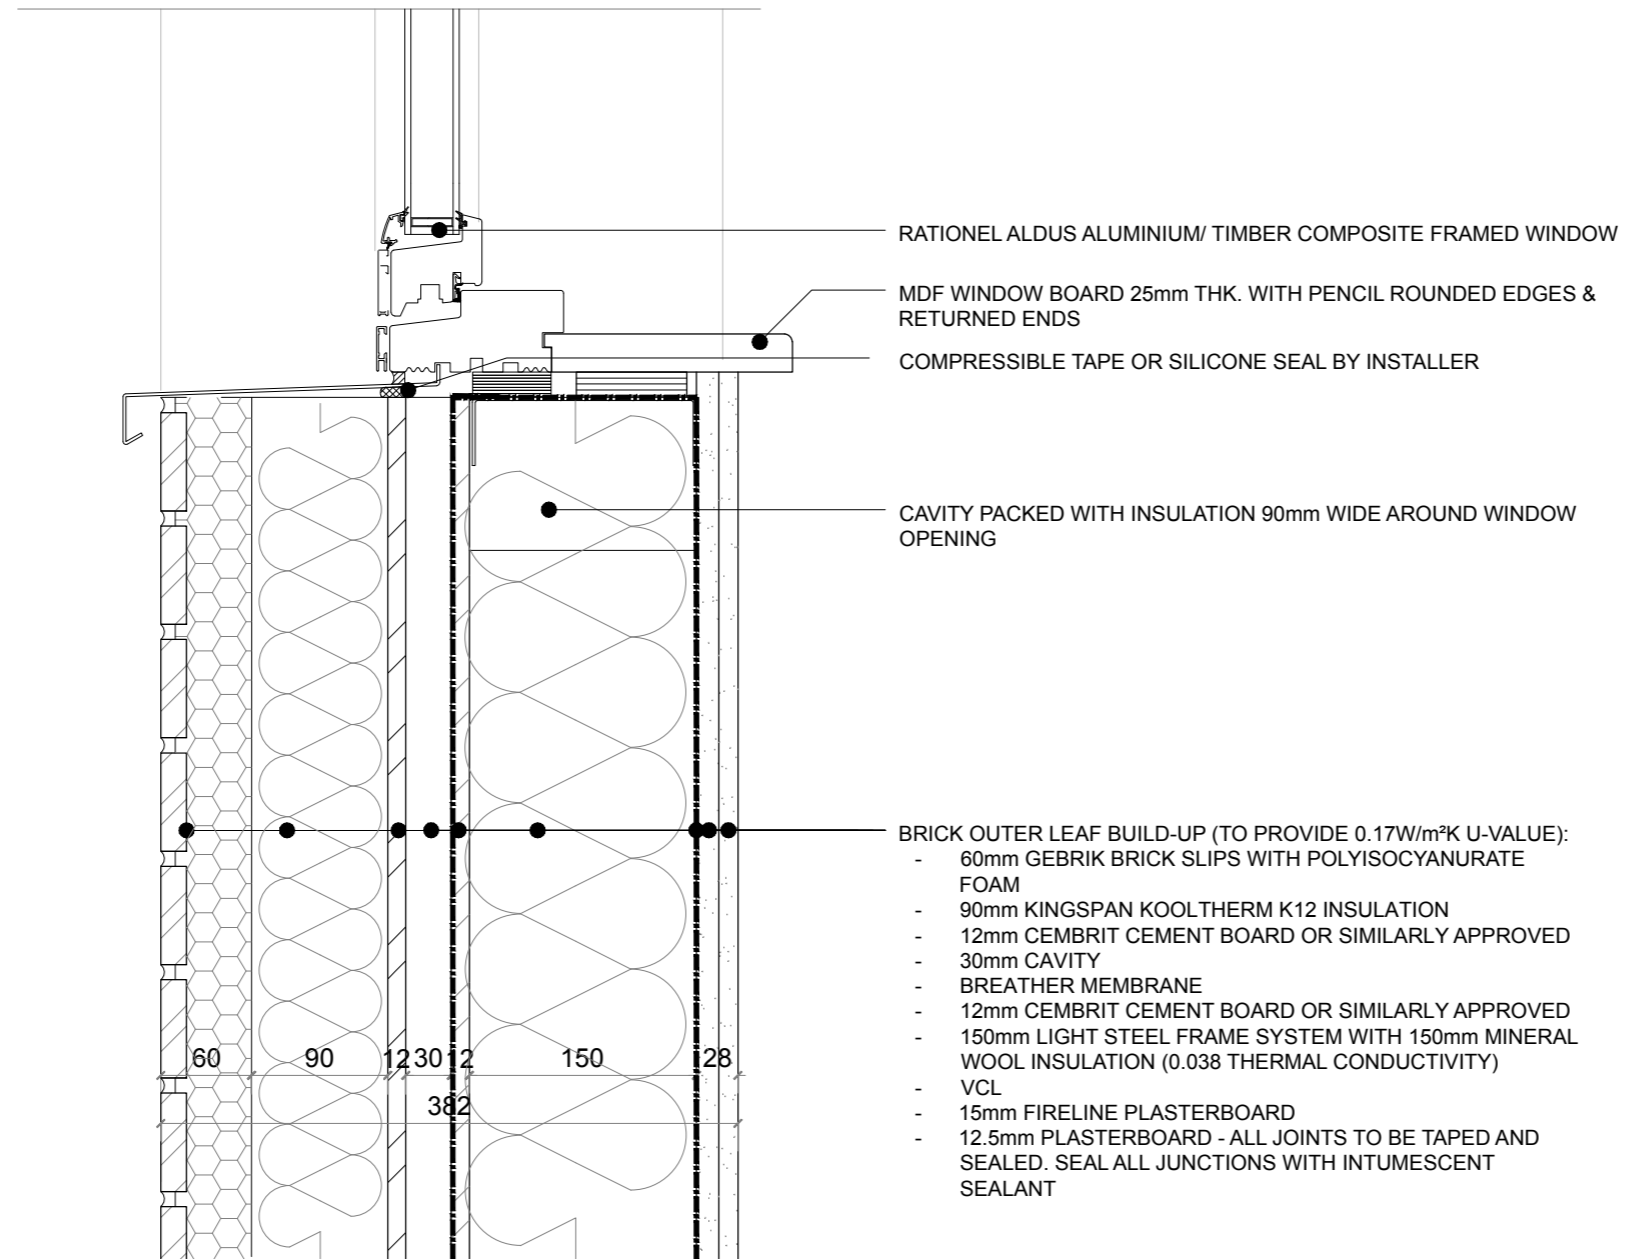

Rev.	Date	Description	Init.
B	26/01/2017	General Build up Amendments	CM
A	13/10/2016	General Build up Amendments	EHG/DW

Client

HADFRAME

Project Title

HADFRAME SYSTEM

Drawing Title

3B5P
WINDOW CILL DETAIL
INSULATED BRICK SLIPS

Cad File	Sheet Size	Scale
1485_DETAILS SET A3	A3	1:5


Drawn by	Drawing Date	Approved by
EHG	AUG 2016	DW

Project No.	Drawing No.	Revision
1485	D04A-11	B

1485 D04A-11 B

This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

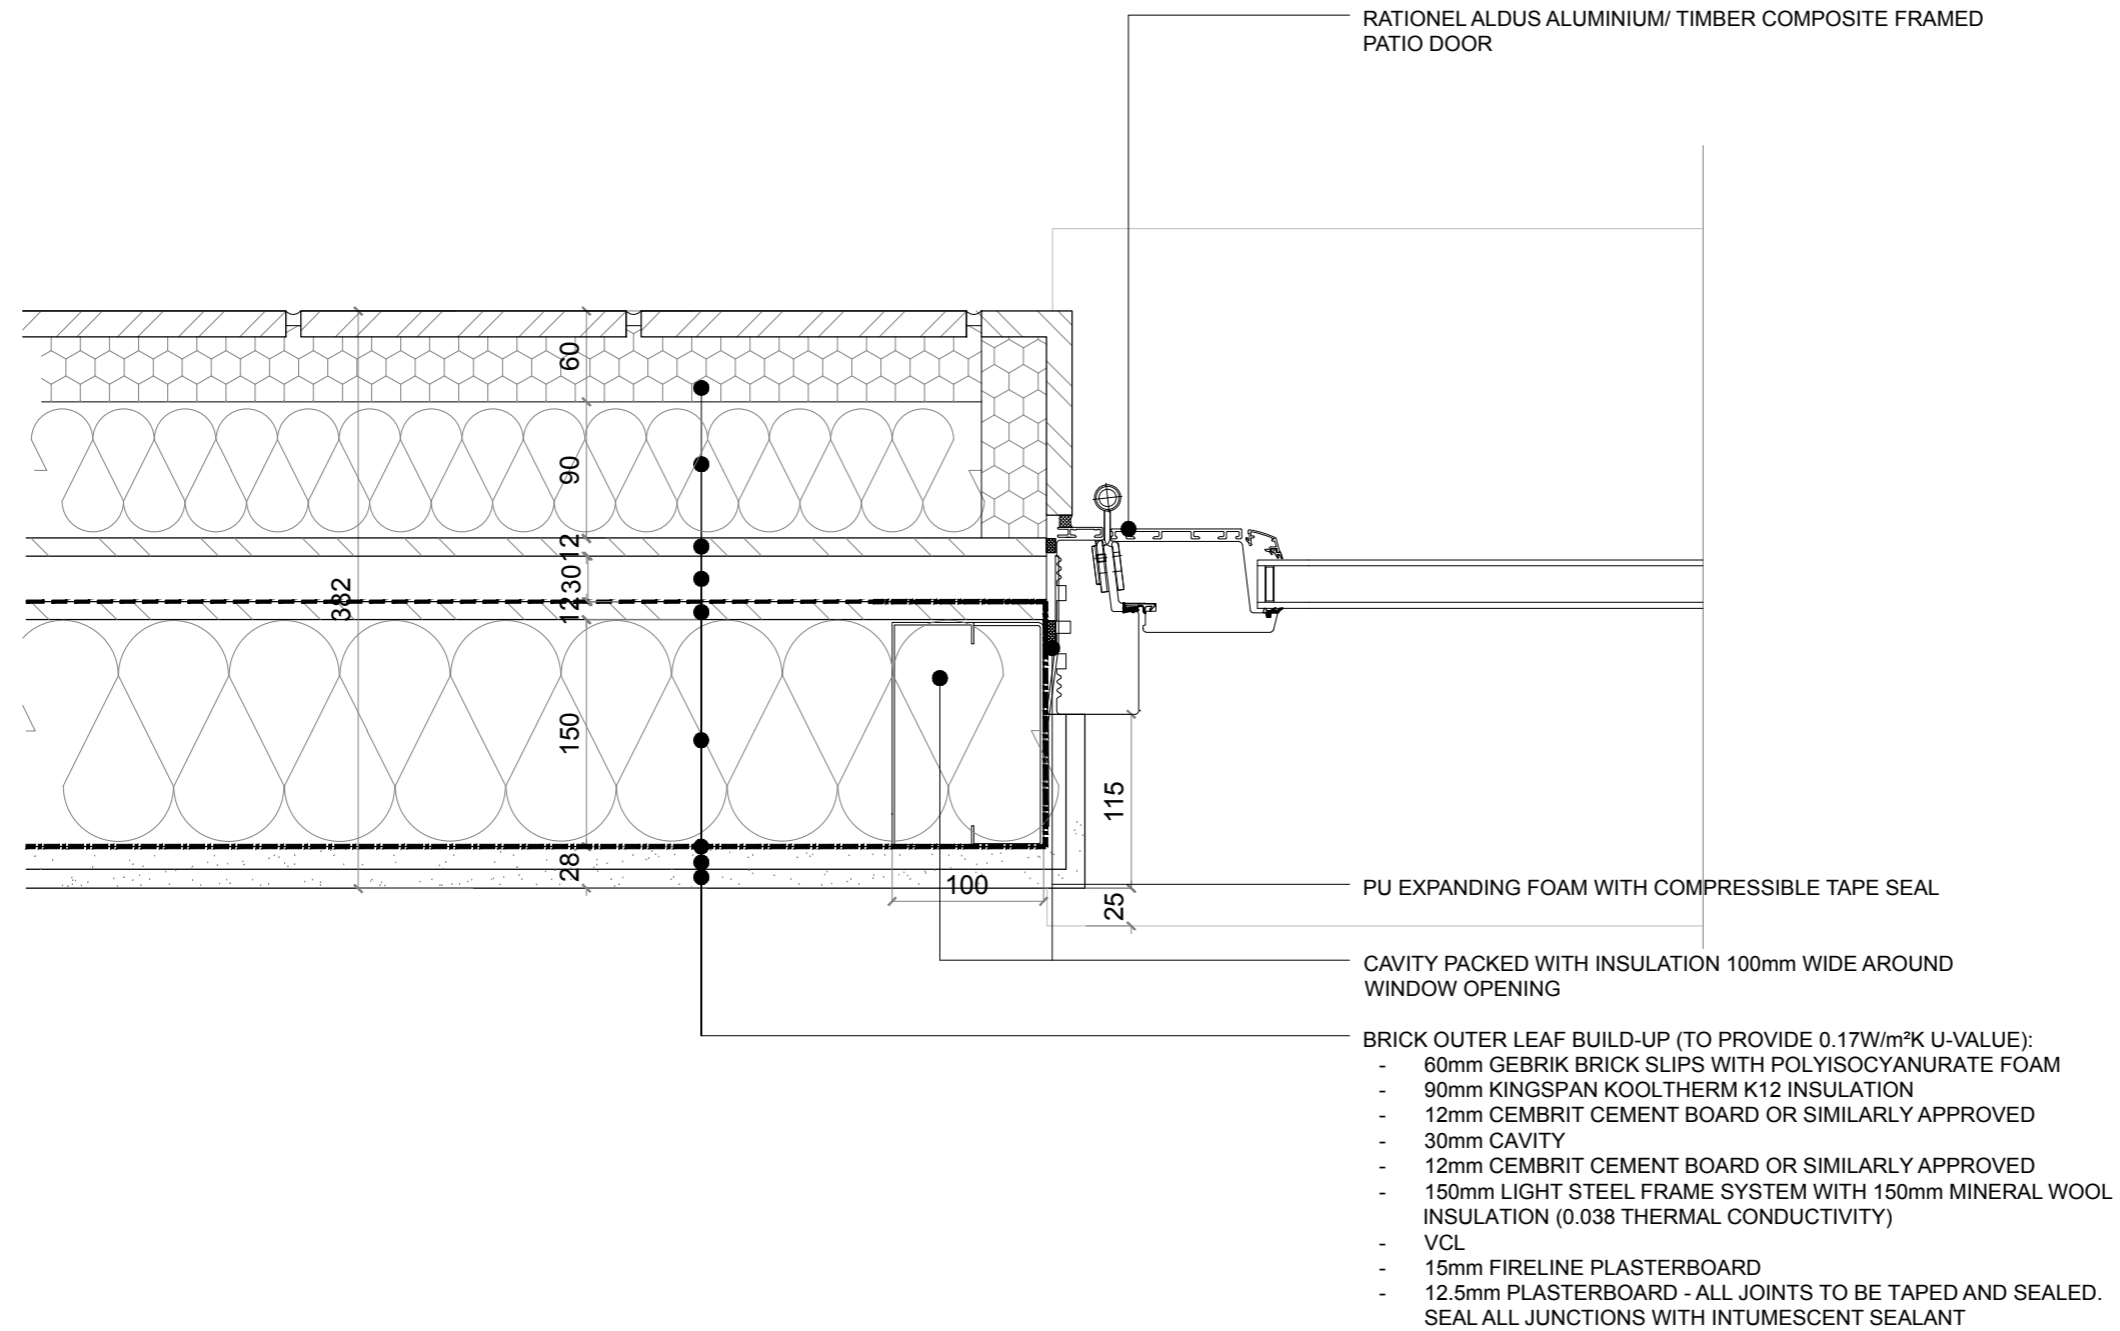

Rev.	Date	Description	Init.
B	26/01/2017	General Build up Amendments	CM
A	14/12/2016	General Build up Amendments	EHG/DW

Client

HADFRAME

Project Title

HADFRAME SYSTEM


Drawing Title
3B5P

**DOOR JAMB DETAIL
INSULATED BRICK SLIPS**

Cad File	Sheet Size	Scale
1485_DETAILS SET A3	A3	1:5
Drawn by	Drawing Date	Approved by
EHG	AUG 2016	DW
Project No.	Drawing No.	Revision
1485	D04A-18	B

This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

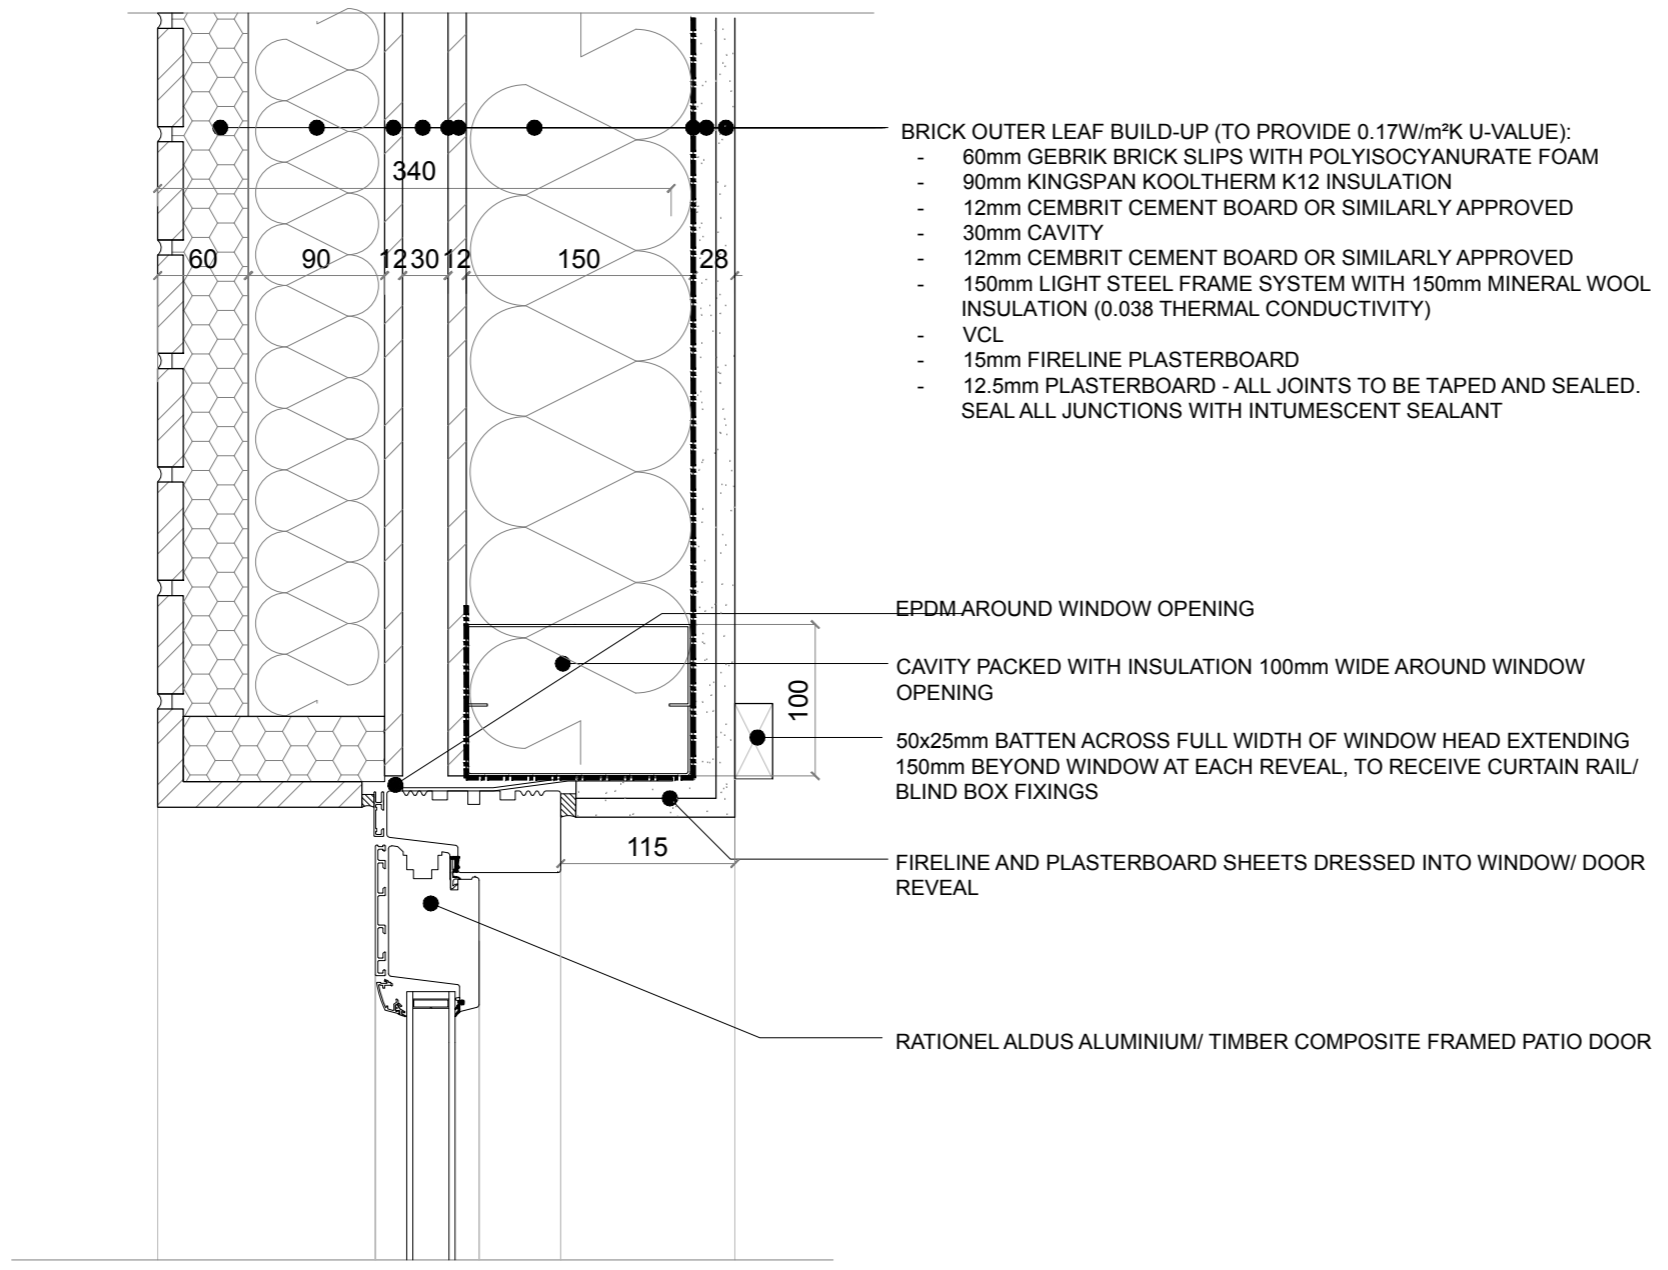

Rev.	Date	Description	Init.
B	26/01/2017	General Build up Amendments	CM
A	14/12/2016	General Build up Amendments	EHG/DW


Client
HADFRAME

Project Title
HADFRAME SYSTEM

Drawing Title 3B5P DOOR HEAD DETAIL INSULATED BRICK SLIPS		
Cad File	Sheet Size	Scale
1485_DETAILS SET A3	A3	1:5
Drawn by	Drawing Date	Approved by
EHG	AUG 2016	DW
Project No.	Drawing No.	Revision
1485	D04A-19	B

This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

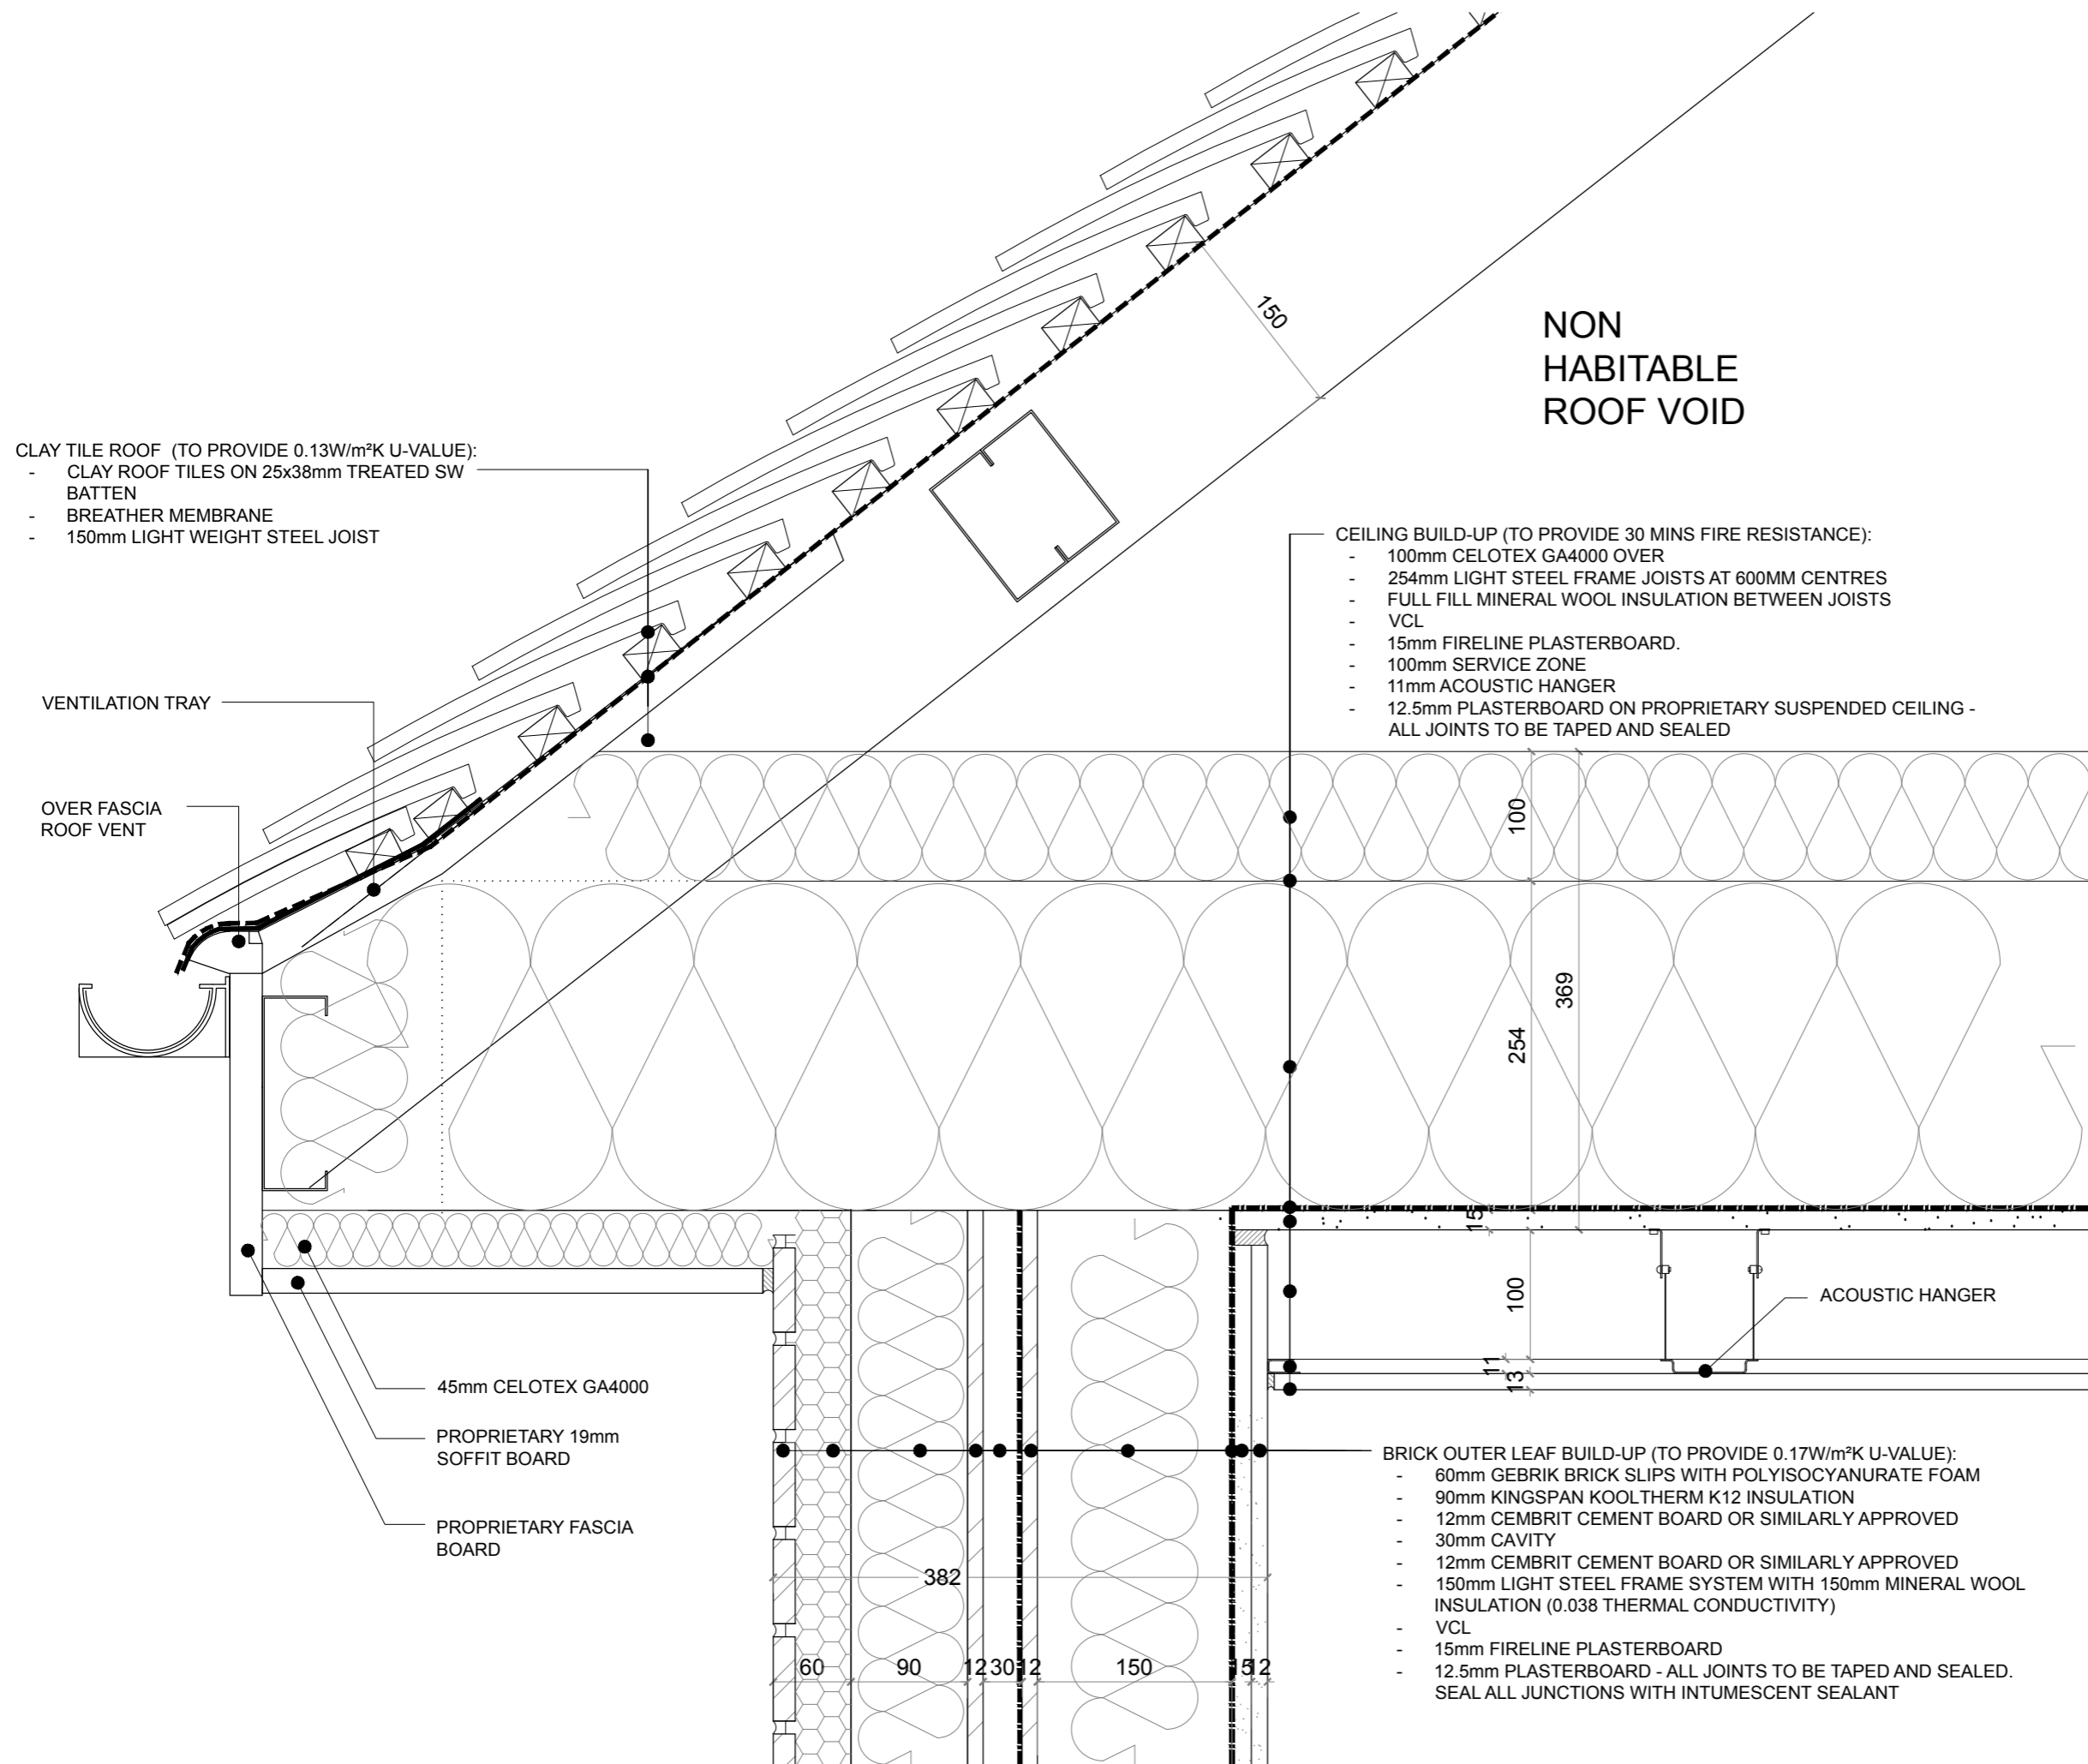

Rev.	Date	Description	Init.
B	26/01/2017	General Build up Amendments	CM
A	14/12/2016	General Build up Amendments	EHG/DW

Client

HADFRAME

Project Title

HADFRAME SYSTEM

Drawing Title
3B5P

TRUSS ROOF EAVES DETAIL
INSULATED BRICK SLIPS

Cad File	Sheet Size	Scale
1485_DETAILS SET A3	A3	1:5

Drawn by	Drawing Date	Approved by
EHG	AUG 2016	DW

Project No.	Drawing No.	Revision
1485	D06A-3	B

1485 D06A-3 B

This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.


PRELIMINARY

HABITABLE
ROOF VOID

- CLAY TILE ROOF (TO PROVIDE 0.13W/m²K U-VALUE):
- CLAY ROOF TILES ON 25x38mm TREATED SW BATTEN
 - BREATHER MEMBRANE
 - 50mm COUNTER BATTEN
 - 100mm THICK ECOTHERM ECO-VERSAL INSULATION
 - 18mm WBP
 - 150mm LIGHT STEEL FRAME SYSTEM WITH 120mm ECOTHERM ECO-VERSAL INSULATION IN BETWEEN

- FLOOR BUILD-UP (TO PROVIDE 30 MINS FIRE RESISTANCE):
- 22mm CHIPBOARD ON VCL
 - 250mm LIGHT STEEL FRAME JOISTS AT 600MM CENTRES WITH 100mm MINERAL WOOL INSULATION (DENSITY BETWEEN 10-43kg/m³)
 - 15mm FIRELINE PLASTERBOARD.
 - 100mm SERVICE ZONE
 - 11mm ACOUSTIC HANGER
 - 12.5mm PLASTERBOARD ON PROPRIETARY SUSPENDED CEILING - ALL JOINTS TO BE TAPED AND SEALED

- BRICK SLIP OUTER LEAF BUILD-UP (TO PROVIDE 0.17W/m²K U-VALUE):
- 60mm GEBRIK BRICK SLIPS WITH POLYISOCYANURATE FOAM
 - 90mm KINGSPAN KOOLTHERM K12 INSULATION
 - 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
 - 30mm CAVITY
 - BREATHER MEMBRANE
 - 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
 - 150mm LIGHT STEEL FRAME SYSTEM WITH 150mm MINERAL WOOL INSULATION (0.038 THERMAL CONDUCTIVITY)
 - VCL
 - 15mm FIRELINE PLASTERBOARD
 - 12.5mm PLASTERBOARD - ALL JOINTS TO BE TAPED AND SEALED. SEAL ALL JUNCTIONS WITH INTUMESCENT SEALANT

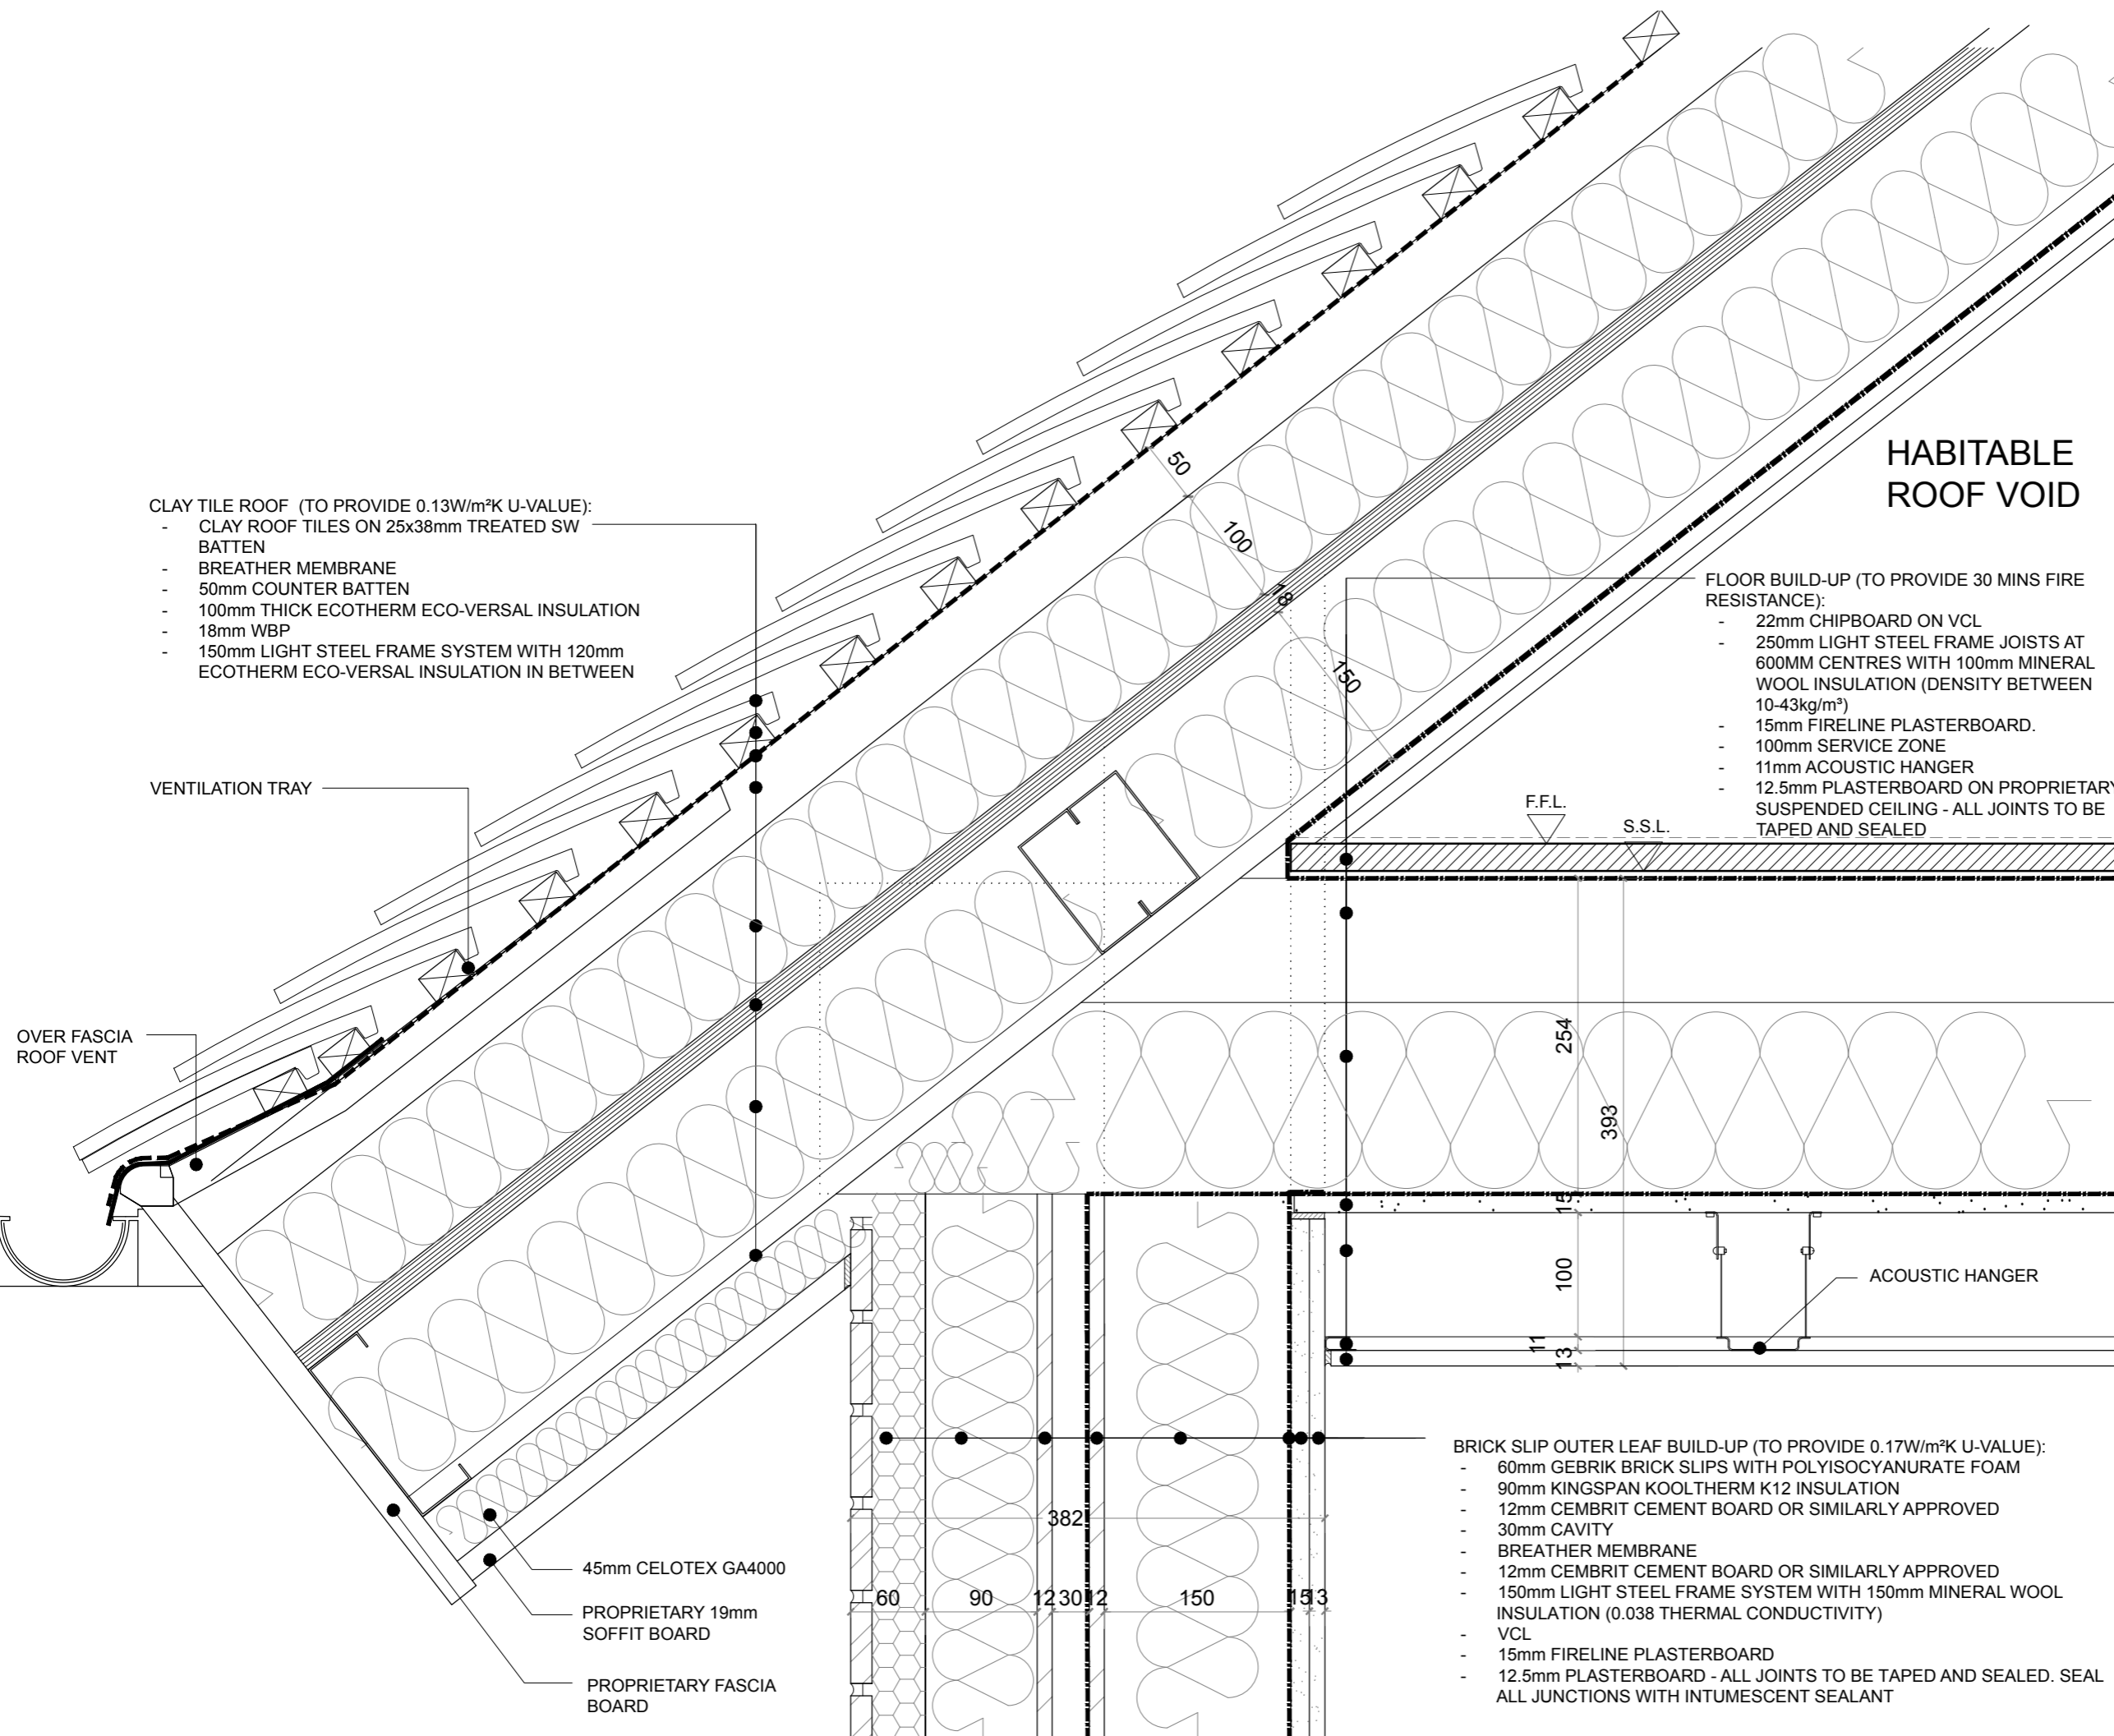

Rev.	Date	Description	Init.
B	26/01/2017	General Build up Amendments	CM
A	14/12/2016	General Build up Amendments	EHG/DW


Client
HADFRAME

Project Title
HADFRAME SYSTEM

Drawing Title 3B5P FRAMED ROOF EAVES DETAIL INSULATED BRICK SLIP		
Cad File	Sheet Size	Scale
1485_DETAILS SET	A3	1:5
Drawn by	Drawing Date	Approved by
EHG	SEPT 2016	DW
Project No.	Drawing No.	Revision
1485	D06A-9	B

This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

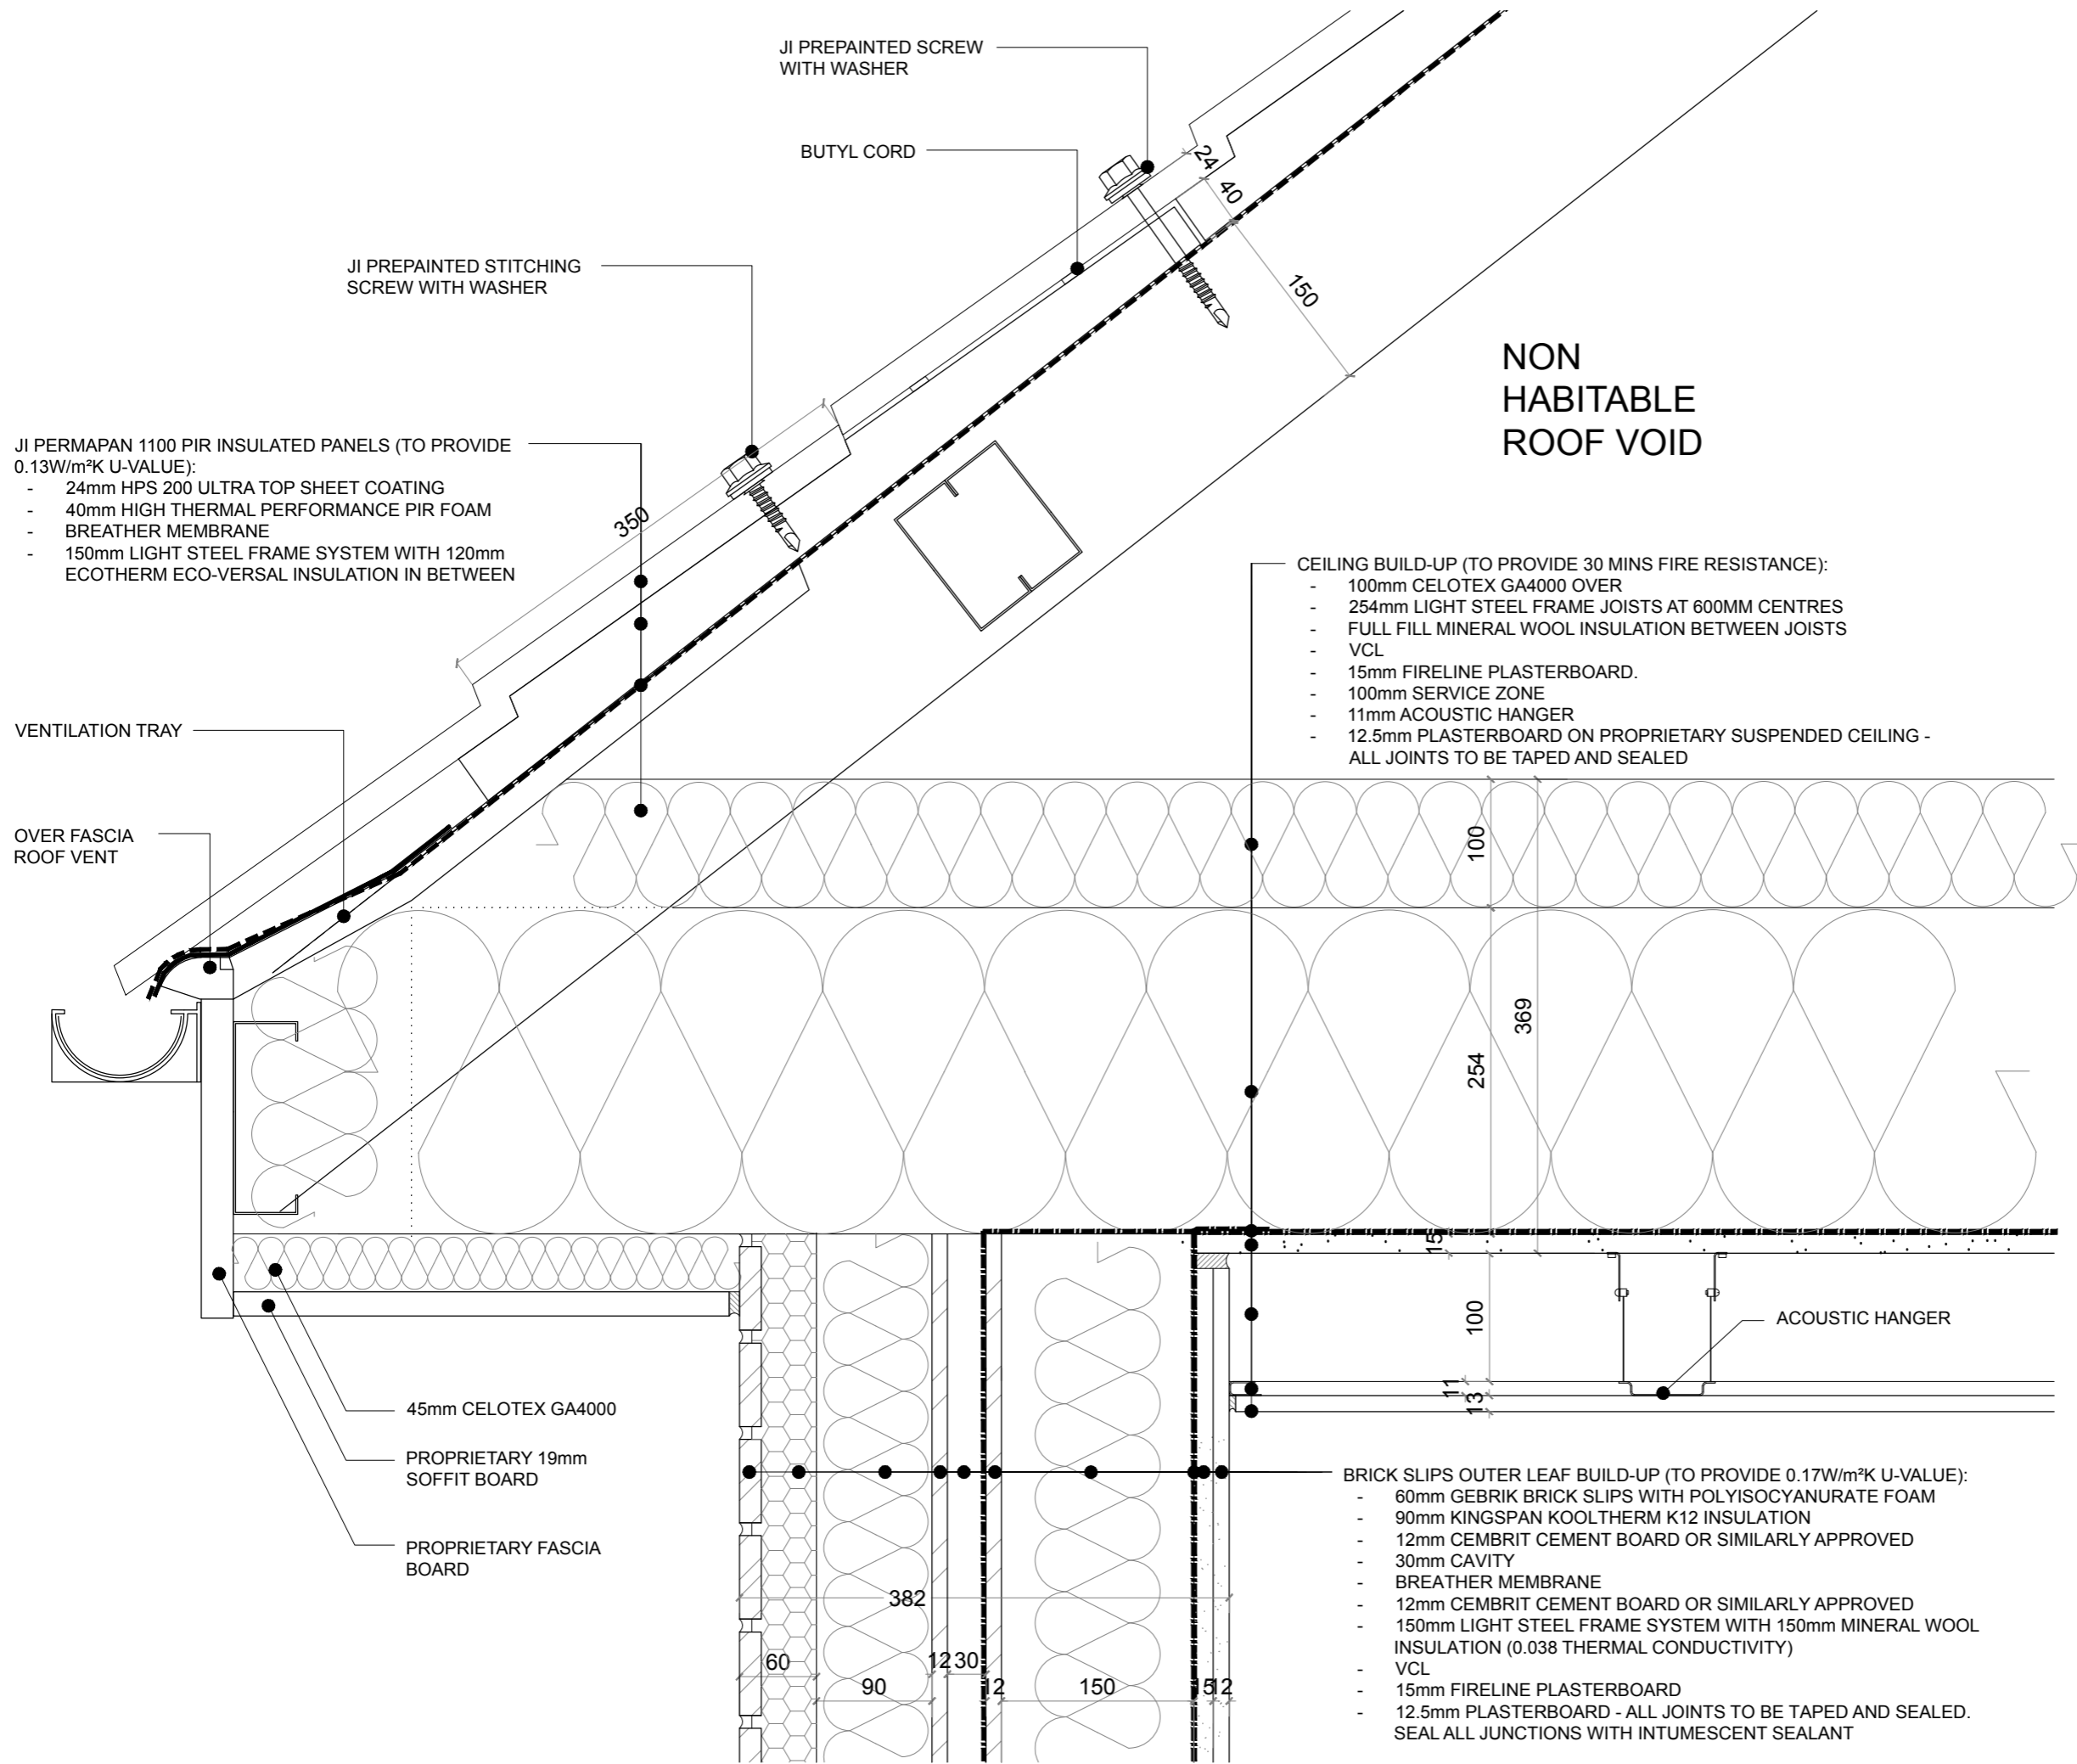


Rev.	Date	Description	Init.
Client			
HADFRAME			
Project Title			
HADFRAME SYSTEM			
Drawing Title			
3B5P			
TRUSS ROOF EAVES DETAIL			
INSULATED BRICK SLIP & COMPOSITE PANEL TILE			
Cad File	Sheet Size	Scale	
1485_DETAILS SET	A3	1:5	
Drawn by	Drawing Date	Approved by	
AM	NOV 2016	DW	
Project No.	Drawing No.	Revision	
1485	D06A-14	-	

This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

- JI PERMAPAN 1100 PIR INSULATED PANELS (TO PROVIDE 0.13W/m²K U-VALUE):
- 24mm HPS 200 ULTRA TOP SHEET COATING
 - 40mm HIGH THERMAL PERFORMANCE PIR FOAM
 - BREATHER MEMBRANE
 - 50mm COUNTER BATTEN
 - 100mm THICK ECOTHERM ECO-VERSAL INSULATION
 - 18mm WBP
 - 150mm LIGHT STEEL FRAME SYSTEM WITH 120mm ECOTHERM ECO-VERSAL INSULATION IN BETWEEN
 - VCL

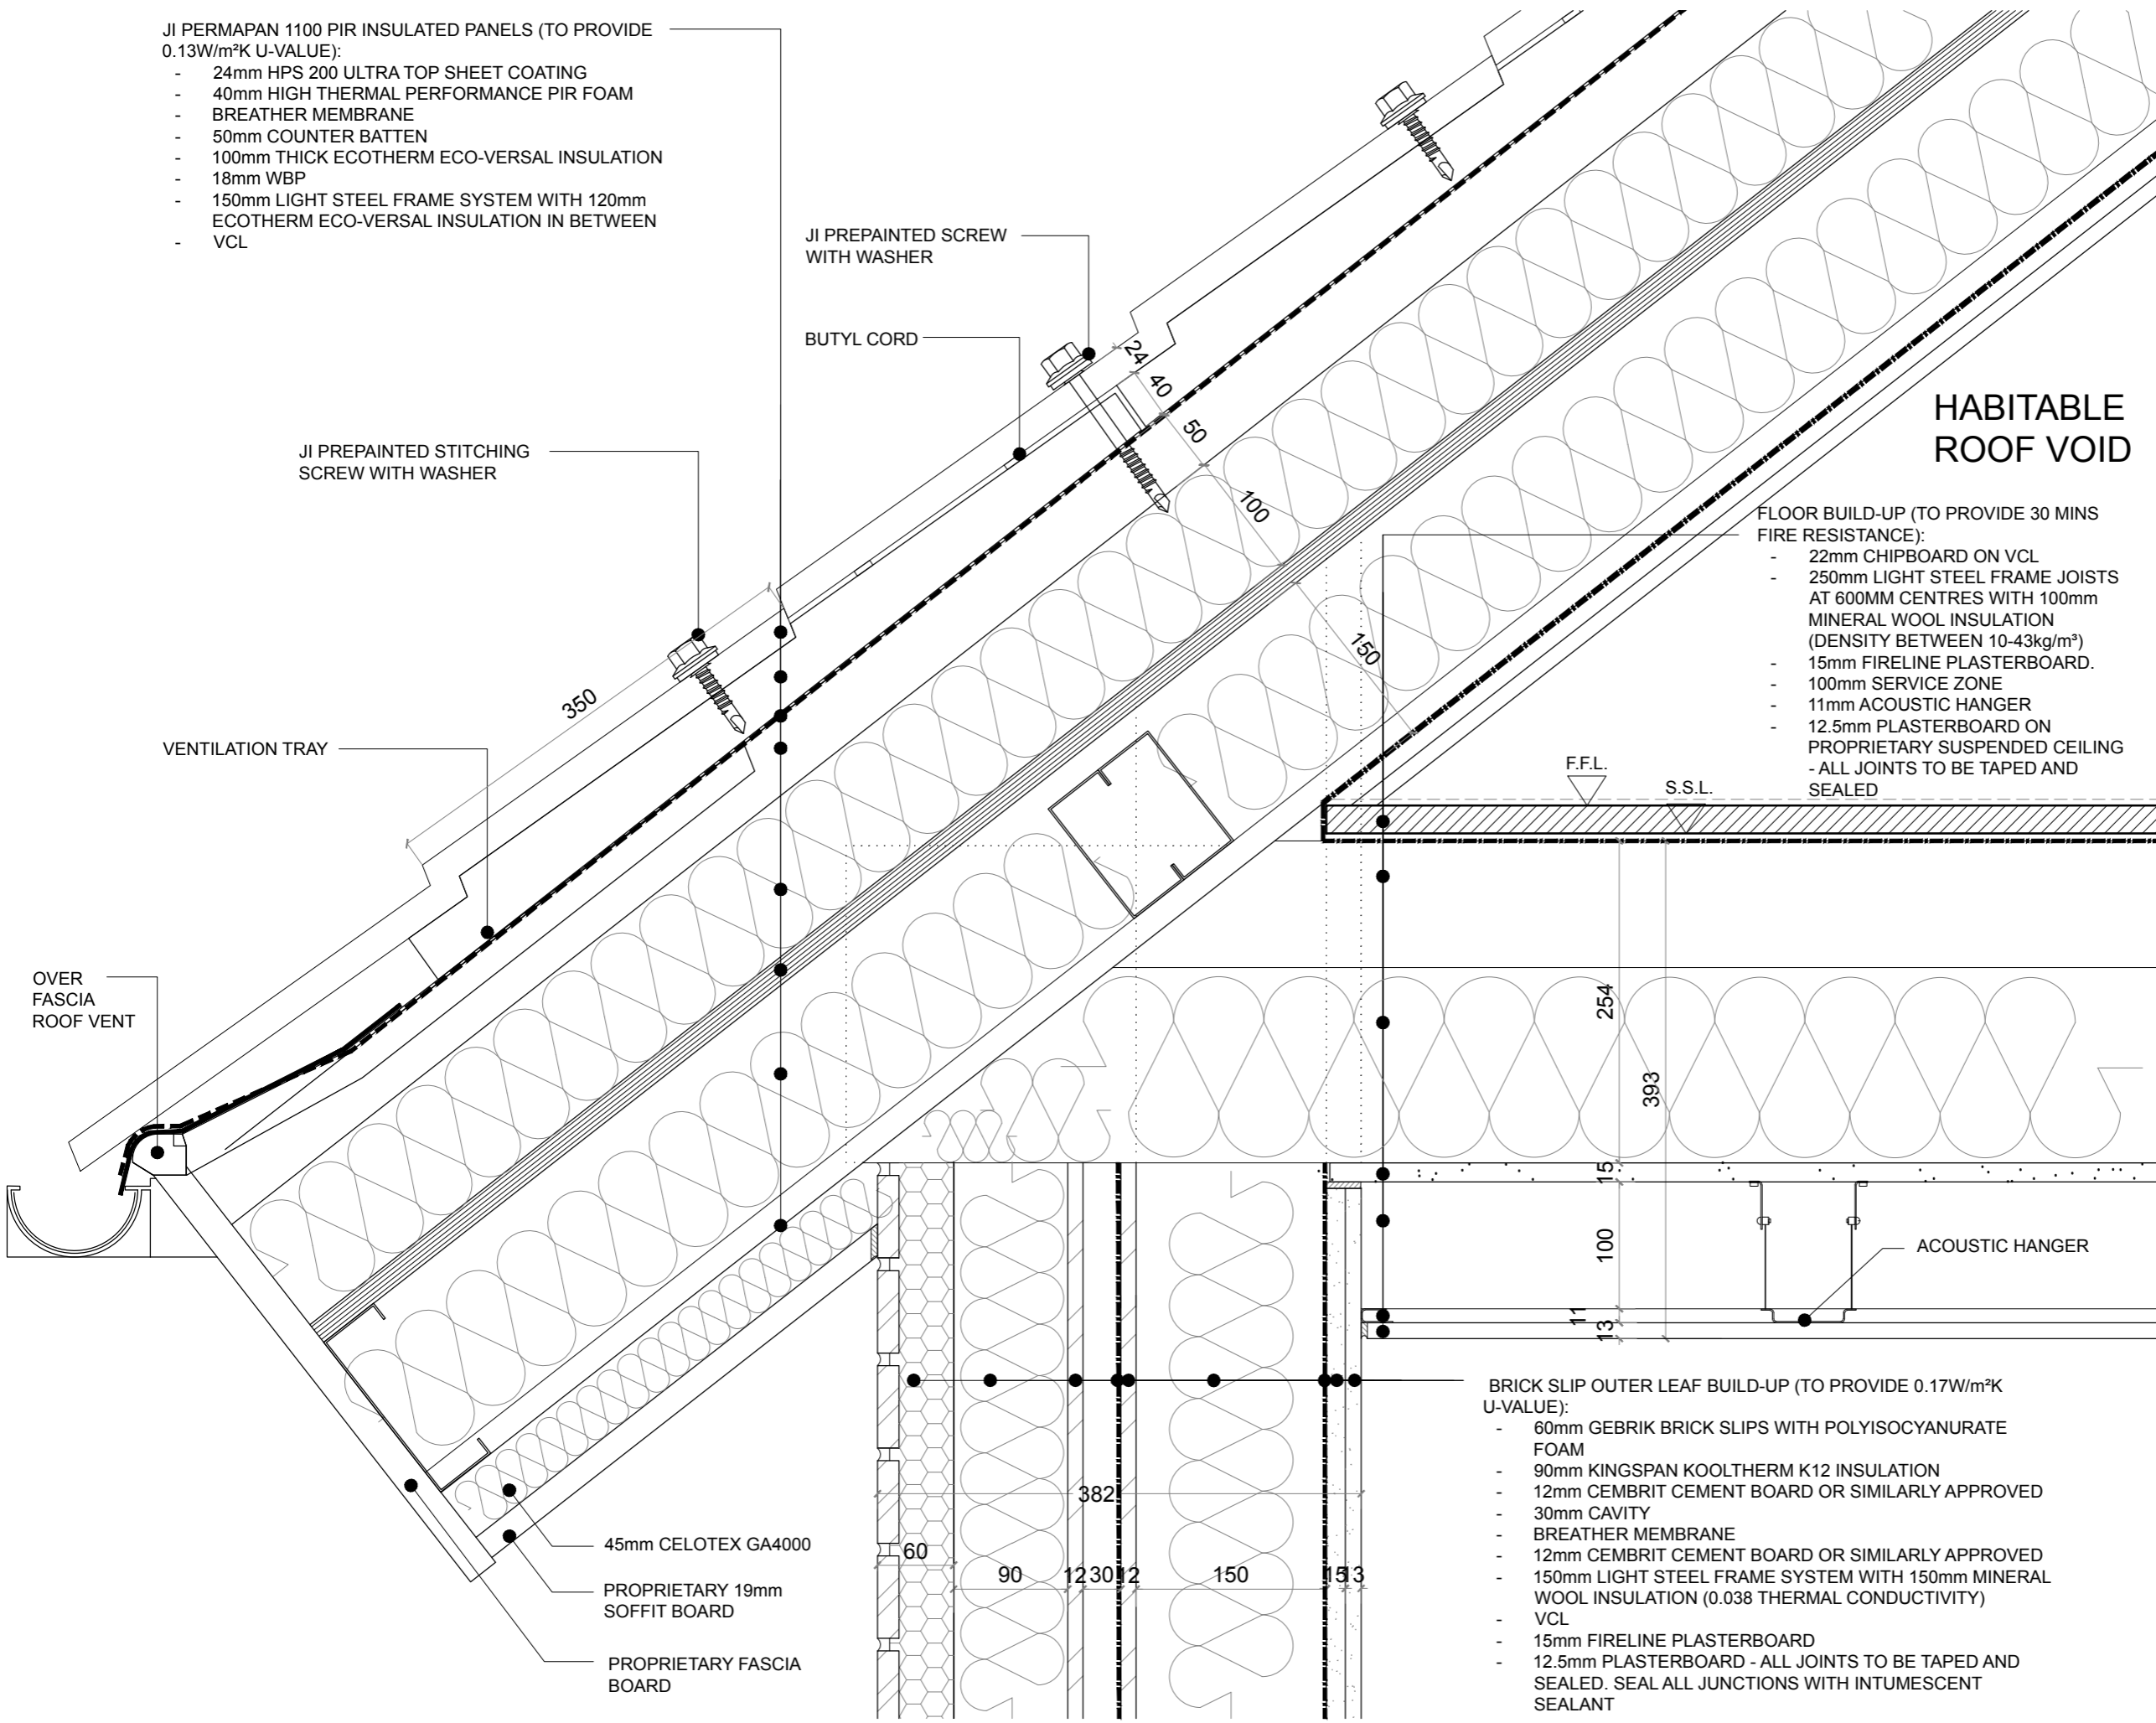

HABITABLE ROOF VOID

- FLOOR BUILD-UP (TO PROVIDE 30 MINS FIRE RESISTANCE):
- 22mm CHIPBOARD ON VCL
 - 250mm LIGHT STEEL FRAME JOISTS AT 600MM CENTRES WITH 100mm MINERAL WOOL INSULATION (DENSITY BETWEEN 10-43kg/m³)
 - 15mm FIRELINE PLASTERBOARD.
 - 100mm SERVICE ZONE
 - 11mm ACOUSTIC HANGER
 - 12.5mm PLASTERBOARD ON PROPRIETARY SUSPENDED CEILING
 - ALL JOINTS TO BE TAPED AND SEALED

- BRICK SLIP OUTER LEAF BUILD-UP (TO PROVIDE 0.17W/m²K U-VALUE):
- 60mm GEBRIK BRICK SLIPS WITH POLYISOCYANURATE FOAM
 - 90mm KINGSPAN KOOLTHERM K12 INSULATION
 - 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
 - 30mm CAVITY
 - BREATHER MEMBRANE
 - 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
 - 150mm LIGHT STEEL FRAME SYSTEM WITH 150mm MINERAL WOOL INSULATION (0.038 THERMAL CONDUCTIVITY)
 - VCL
 - 15mm FIRELINE PLASTERBOARD
 - 12.5mm PLASTERBOARD - ALL JOINTS TO BE TAPED AND SEALED. SEAL ALL JUNCTIONS WITH INTUMESCENT SEALANT

Rev.	Date	Description	Init.
Client			
HADFRAME			
Project Title			
HADFRAME SYSTEM			
Drawing Title			
3B5P			
FRAMED ROOF EAVES DETAIL			
INSULATED BRICK SLIP & COMPOSITE PANEL TILE			
Cad File	Sheet Size	Scale	
1485_DETAILS SET	A3	1:5	
Drawn by	Drawing Date	Approved by	
AM	NOV 2016	DW	
Project No.	Drawing No.	Revision	
1485	D06A-19	-	



This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

HABITABLE ROOF VOID

CLAY TILE ROOF (TO PROVIDE 0.13W/m²K U-VALUE):


- CLAY ROOF TILES ON 25x38mm TREATED SW BATTEN
- BREATHER MEMBRANE
- 50mm COUNTER BATTEN
- 100mm THICK ECOTHERM ECO-VERSAL INSULATION
- 18mm WBP
- 150mm LIGHT STEEL FRAME SYSTEM WITH 2 LAYERS OF 120mm ECOTHERM ECO-VERSAL INSULATION IN BETWEEN
- VCL
- 15mm FIRELINE PLASTERBOARD.
- 12.5mm PLASTERBOARD
- ALL JOINTS TO BE TAPED AND SEALED

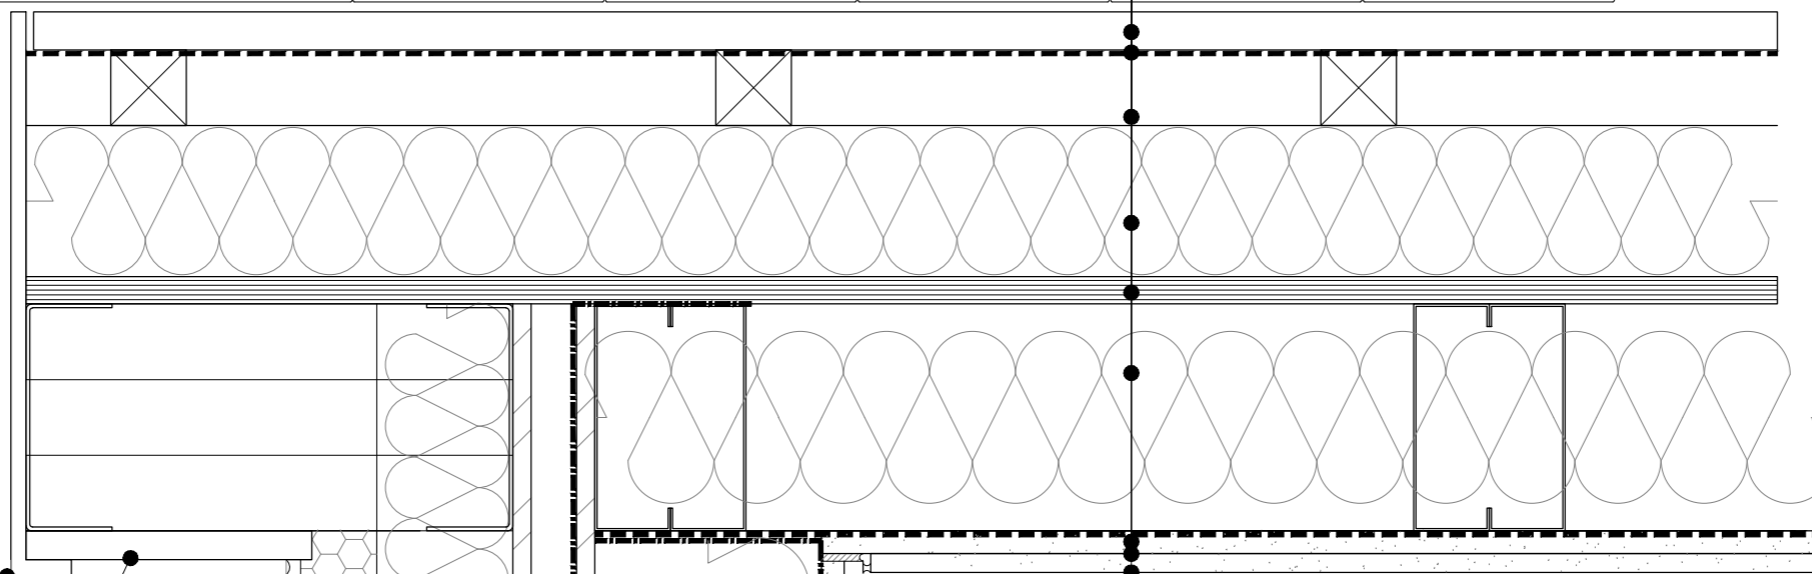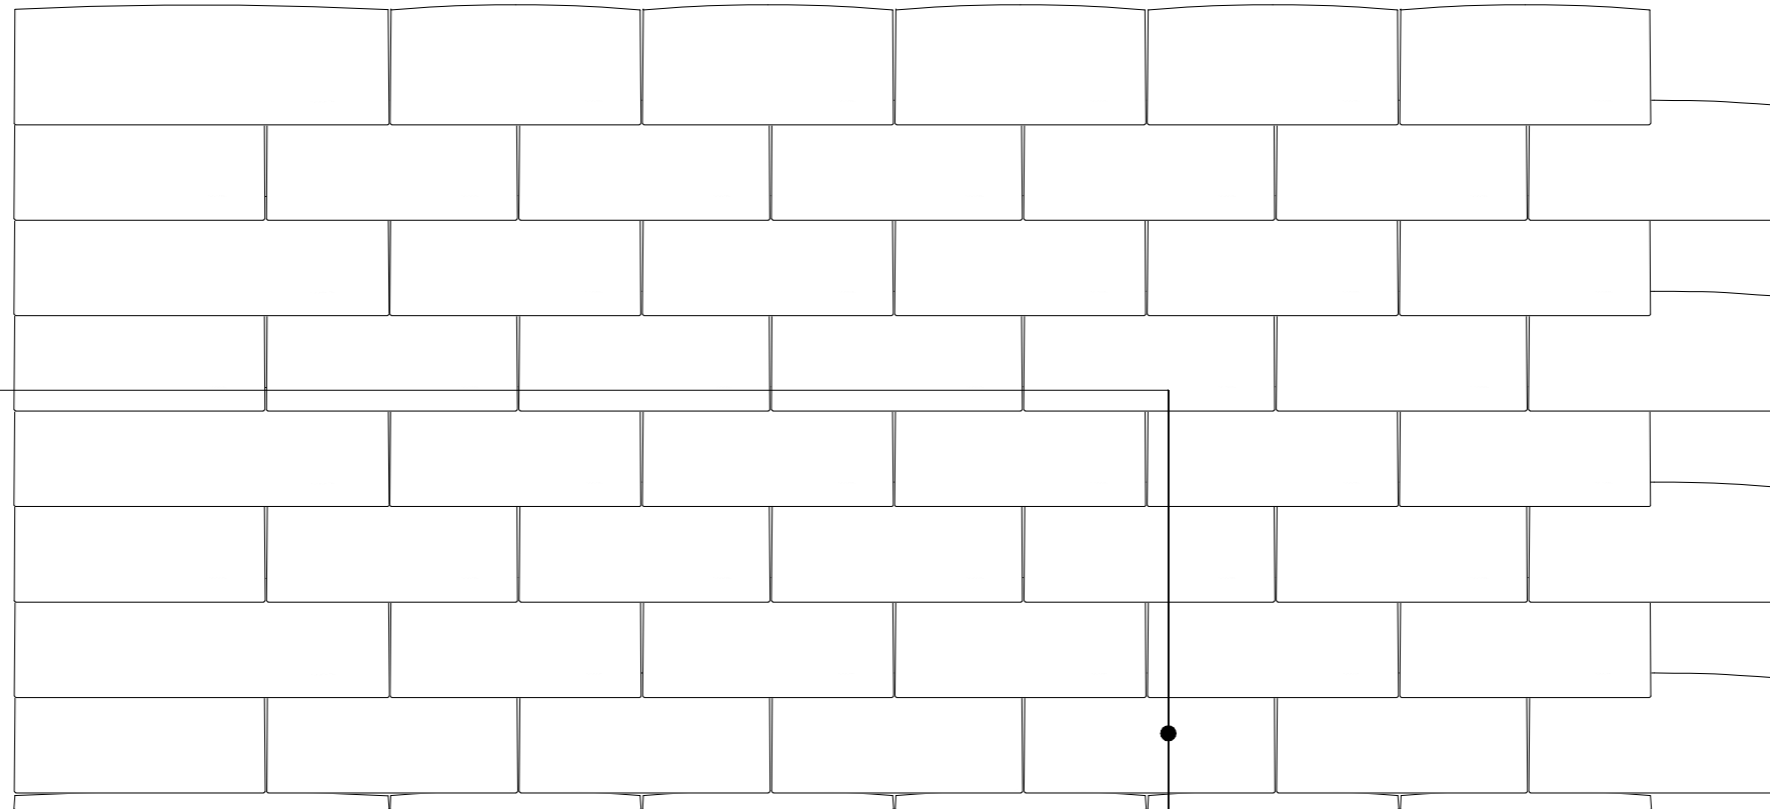

PVC FASCIA BOARD

182

PROPRIETARY 19mm SOFFIT BOARD

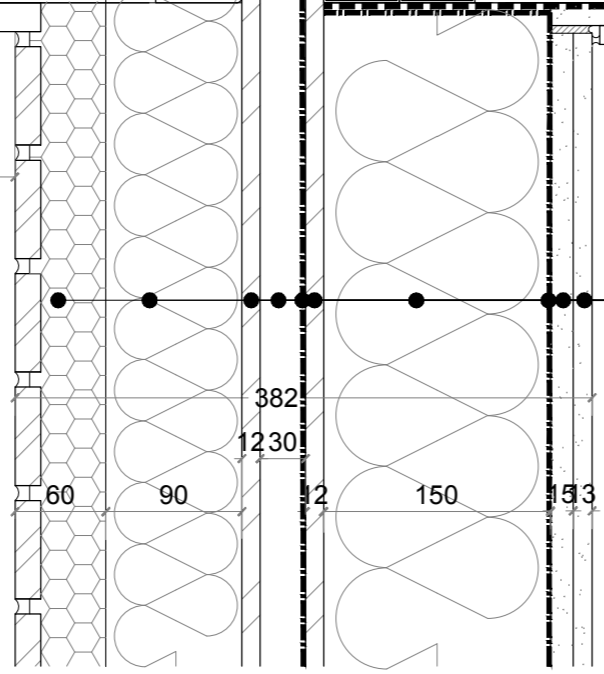

BRICK SLIP OUTER LEAF BUILD-UP (TO PROVIDE 0.17W/m²K U-VALUE):

- 60mm GEBRIK BRICK SLIPS WITH POLYISOCYANURATE FOAM
- 90mm KINGSPAN KOOLTHERM K12 INSULATION
- 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
- 30mm CAVITY
- BREATHER MEMBRANE
- 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
- 150mm LIGHT STEEL FRAME SYSTEM WITH 150mm MINERAL WOOL INSULATION (0.038 THERMAL CONDUCTIVITY)
- VCL
- 15mm FIRELINE PLASTERBOARD
- 12.5mm PLASTERBOARD - ALL JOINTS TO BE TAPED AND SEALED. ALL JUNCTIONS WITH INTUMESCENT SEALANT

382

1230

60

90

2

150

153

Rev.	Date	Description	Init.
Client			
HADFRAME			
Project Title			
HADFRAME SYSTEM			
Drawing Title			
3B5P			
VERGE DETAIL - CLAY ROOF TILES			
INSULATED BRICK SLIP			
Cad File	Sheet Size	Scale	
1485_DETAILS SET	A3	1:5	
Drawn by	Drawing Date	Approved by	
AM	NOV 2016	DW	
Project No.	Drawing No.	Revision	
1485	D06A-28	-	


SEAL This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

HABITABLE ROOF VOID

JI PERMAPAN 1100 PIR INSULATED PANELS (TO PROVIDE 0.13W/m²K U-VALUE):

- 24mm HPS 200 ULTRA TOP SHEET COATING
- 40mm HIGH THERMAL PERFORMANCE PIR FOAM
- BREATHER MEMBRANE
- 150mm LIGHT STEEL FRAME SYSTEM WITH 120mm ECOTHERM ECO-VERSAL INSULATION IN BETWEEN
- VCL
- 15mm FIRELINE PLASTERBOARD.
- 12.5mm PLASTERBOARD
- ALL JOINTS TO BE TAPED AND SEALED

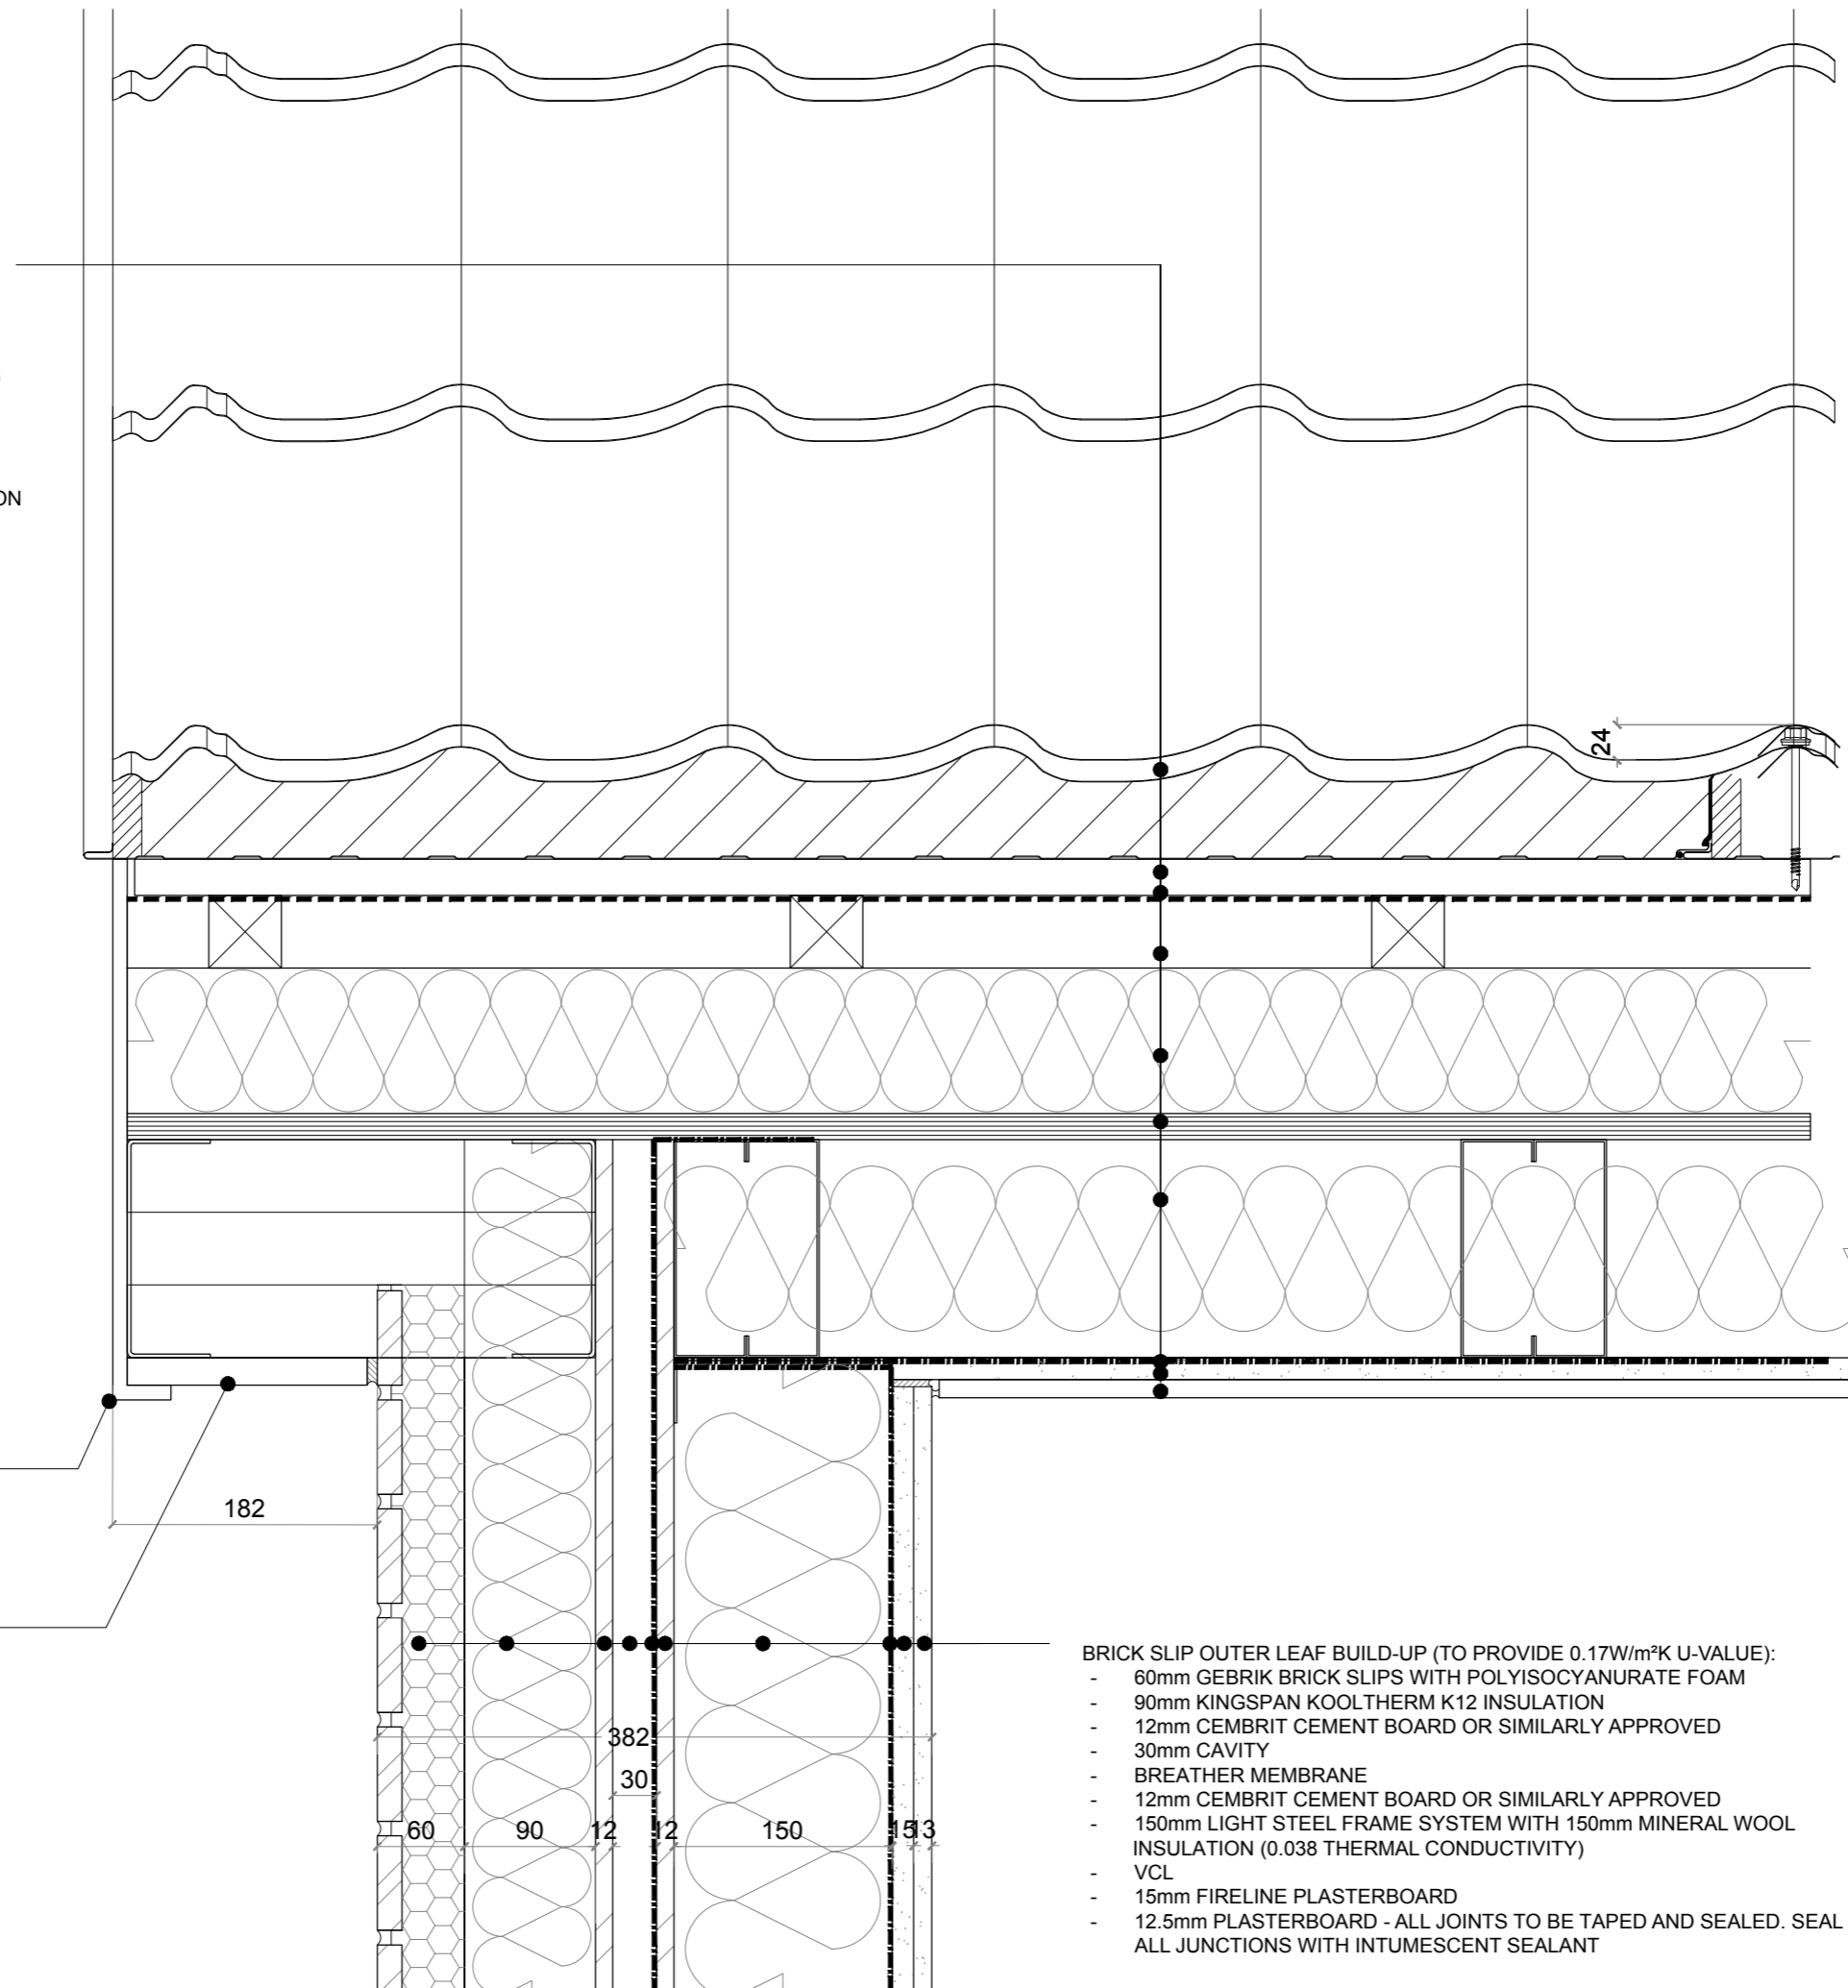

PVC FASCIA BOARD

PROPRIETARY 19mm SOFFIT BOARD

- BRICK SLIP OUTER LEAF BUILD-UP (TO PROVIDE 0.17W/m²K U-VALUE):
- 60mm GEBRIK BRICK SLIPS WITH POLYISOCYANURATE FOAM
 - 90mm KINGSPAN KOOLTHERM K12 INSULATION
 - 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
 - 30mm CAVITY
 - BREATHER MEMBRANE
 - 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
 - 150mm LIGHT STEEL FRAME SYSTEM WITH 150mm MINERAL WOOL INSULATION (0.038 THERMAL CONDUCTIVITY)
 - VCL
 - 15mm FIRELINE PLASTERBOARD
 - 12.5mm PLASTERBOARD - ALL JOINTS TO BE TAPED AND SEALED. SEAL ALL JUNCTIONS WITH INTUMESCENT SEALANT

Rev.	Date	Description	Init.
Client			
HADFRAME			
Project Title			
HADFRAME SYSTEM			
Drawing Title			
3B5P			
VERGE DETAIL - COMPOSITE PANEL TILE INSULATED BRICK SLIP			
Cad File	Sheet Size	Scale	
1485_DETAILS SET A3	A3	1:5	
Drawn by	Drawing Date	Approved by	
AM	NOV 2016	DW	
Project No.	Drawing No.	Revision	
1485	D06A-33	-	



This drawing is property of Daria Wong Architects © and must not be copied or otherwise reproduced. All dimensions must be checked on site before commencing work. No dimensions to be scaled from this drawing. This drawing was produced using AutoCad LT.

PRELIMINARY

NON-HABITABLE ROOF VOID

CLAY TILE ROOF (TO PROVIDE 0.13W/m²K U-VALUE):

- CLAY ROOF TILES ON 25x38mm TREATED SW BATTEN
- BREATHER MEMBRANE
- 50mm COUNTER BATTEN
- 150mm LIGHT STEEL FRAME SYSTEM WITH 2 LAYERS OF 120mm ECOTHERM ECO-VERSAL INSULATION IN BETWEEN
- VCL
- 15mm FIRELINE PLASTERBOARD.
- 12.5mm PLASTERBOARD
- ALL JOINTS TO BE TAPED AND SEALED

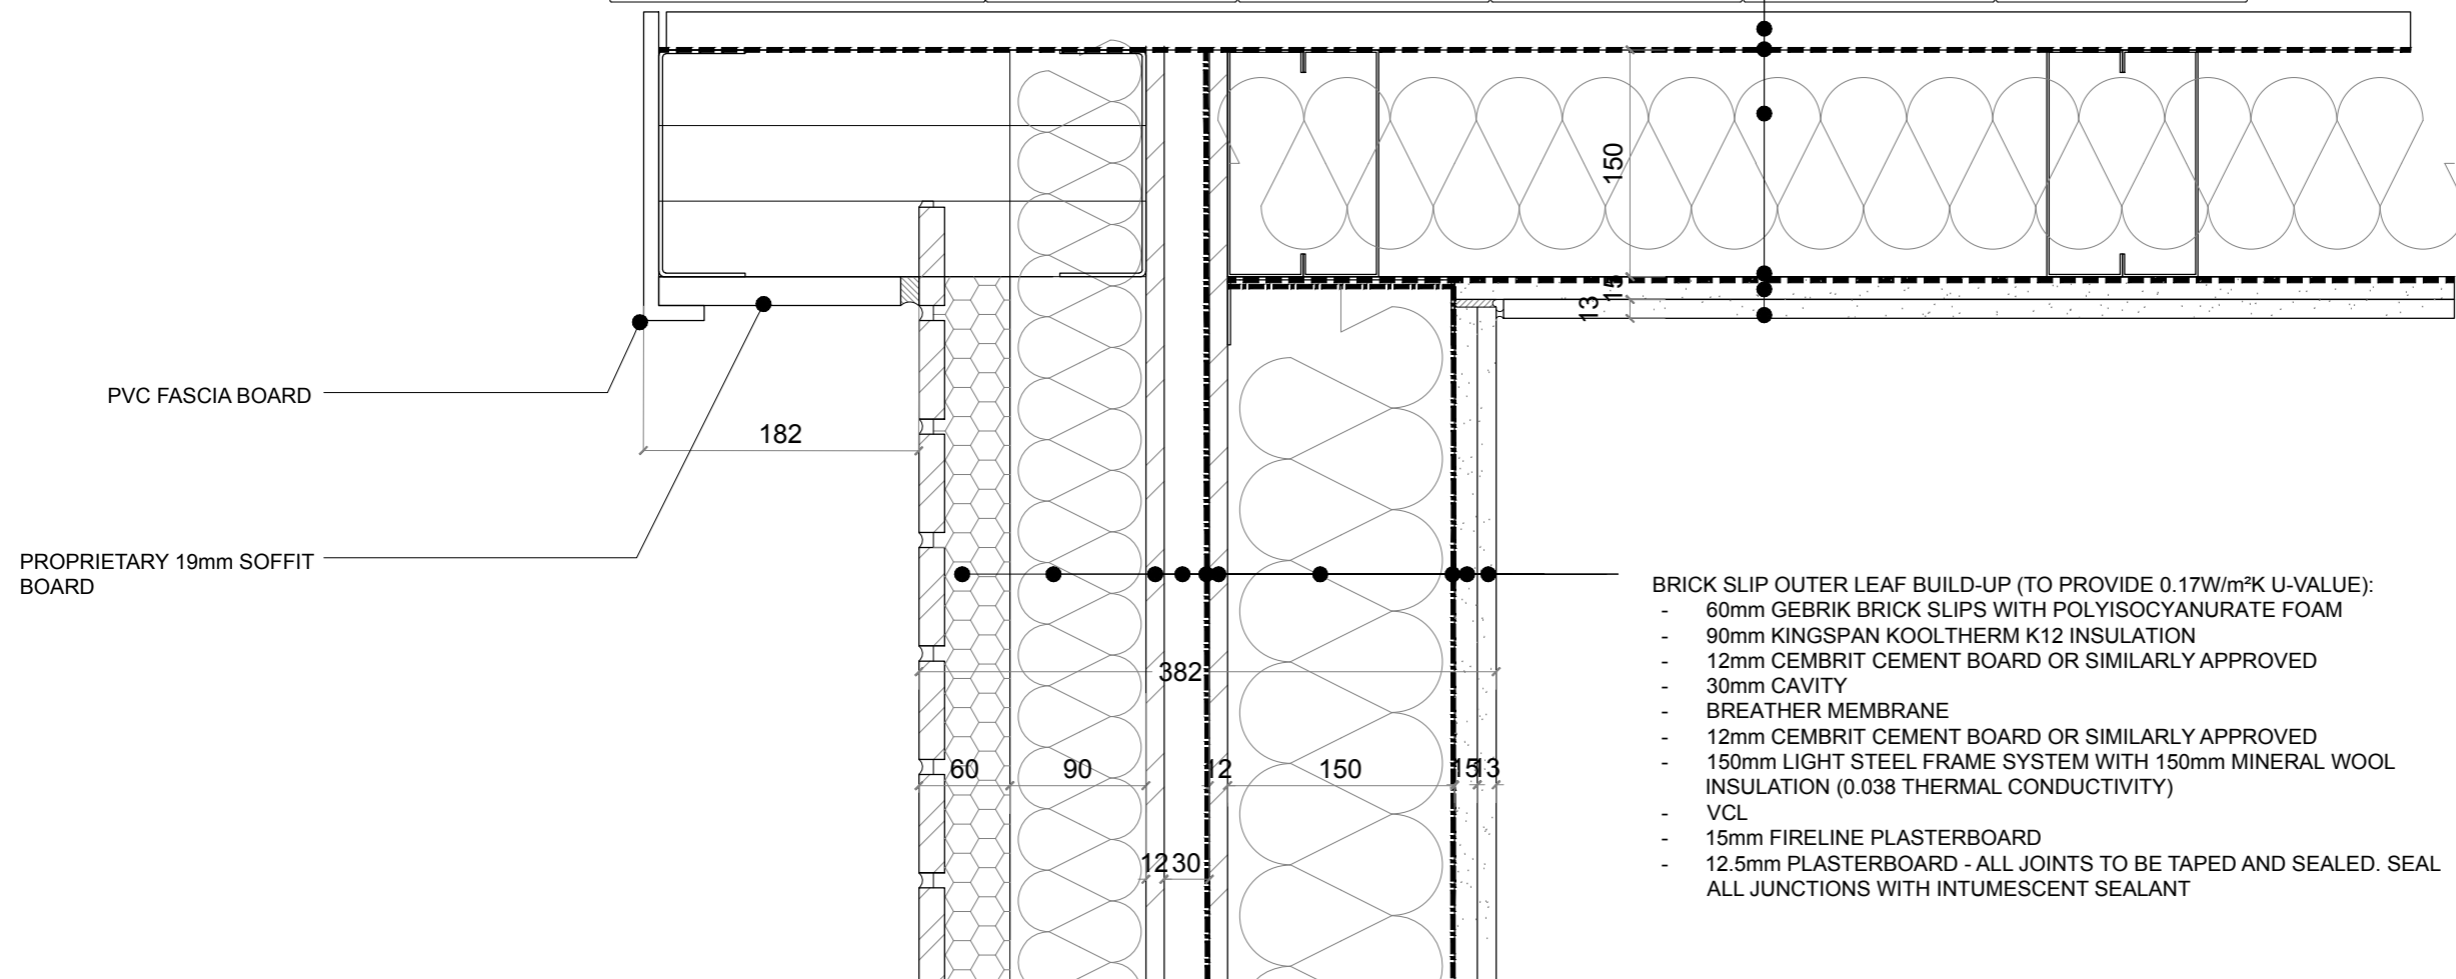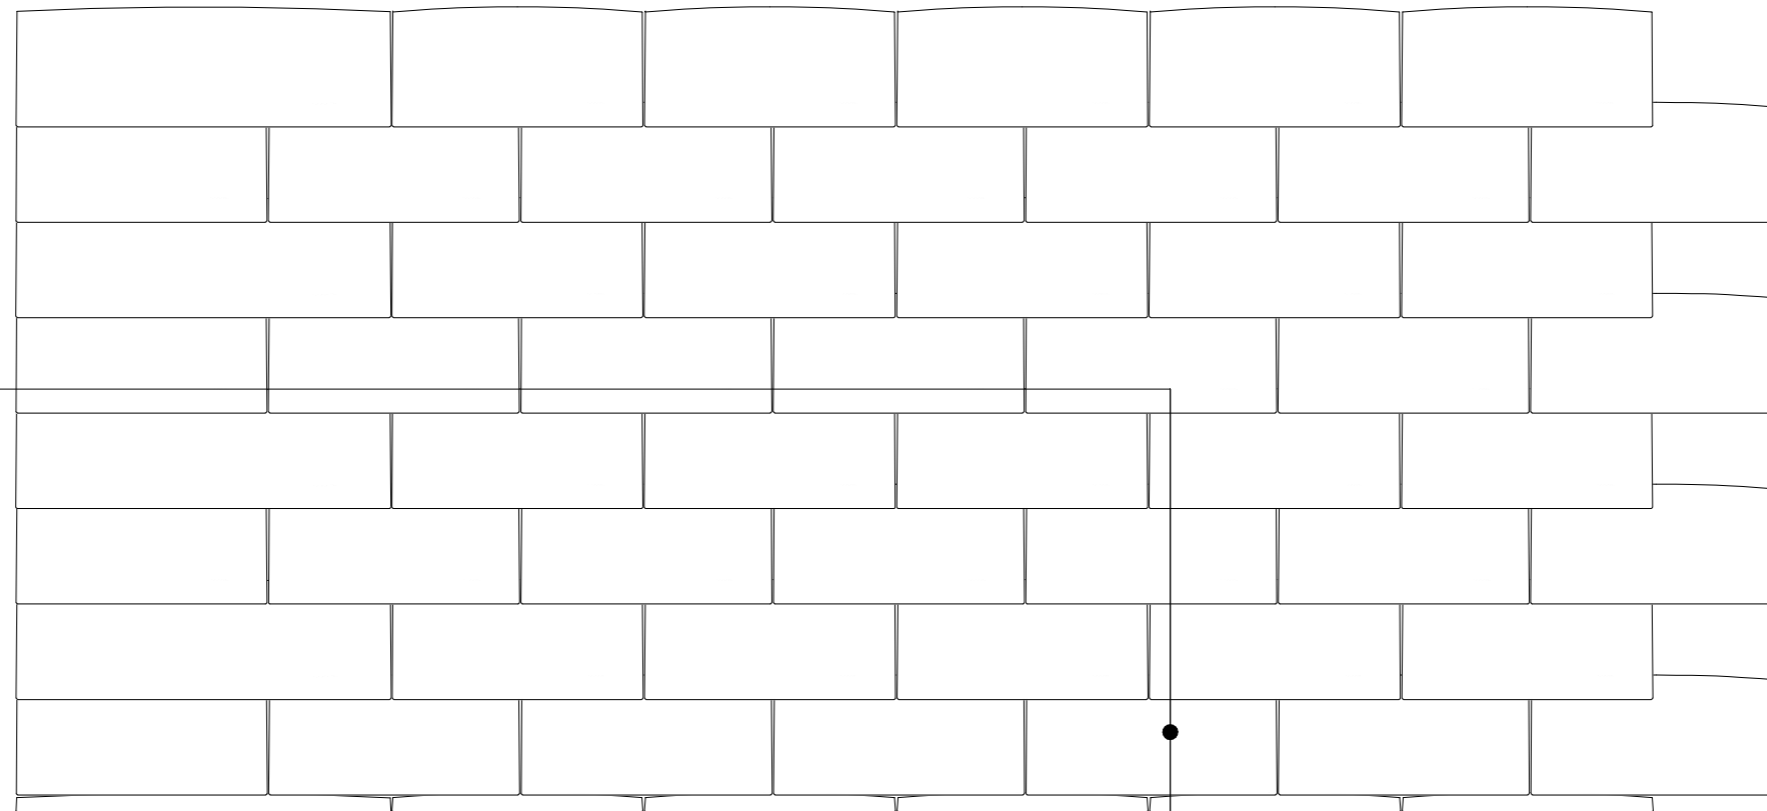

BRICK SLIP OUTER LEAF BUILD-UP (TO PROVIDE 0.17W/m²K U-VALUE):

- 60mm GEBRIK BRICK SLIPS WITH POLYISOCYANURATE FOAM
- 90mm KINGSPAN KOOLTHERM K12 INSULATION
- 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
- 30mm CAVITY
- BREATHER MEMBRANE
- 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
- 150mm LIGHT STEEL FRAME SYSTEM WITH 150mm MINERAL WOOL INSULATION (0.038 THERMAL CONDUCTIVITY)
- VCL
- 15mm FIRELINE PLASTERBOARD
- 12.5mm PLASTERBOARD - ALL JOINTS TO BE TAPED AND SEALED. SEAL ALL JUNCTIONS WITH INTUMESCENT SEALANT

Rev.	Date	Description	Init.
------	------	-------------	-------

Client

HADFRAME

Project Title

HADFRAME SYSTEM

Drawing Title

3B5P

**VERGE DETAIL - CLAY ROOF TILE
INSULATED BRICK SLIP**

Cad File	Sheet Size	Scale
----------	------------	-------

1485_DETAILS SET	A3	1:5
------------------	----	-----

Drawn by	Drawing Date	Approved by
----------	--------------	-------------

AM	NOV 2016	DW
----	----------	----




Project No.	Drawing No.	Revision
-------------	-------------	----------

1485	D06A-38	—
------	---------	---

NON-HABITABLE
ROOF VOID

JI PERMAPAN 1100 PIR INSULATED PANELS (TO PROVIDE 0.13W/m²K U-VALUE):

- 24mm HPS 200 ULTRA TOP SHEET COATING
- 40mm HIGH THERMAL PERFORMANCE PIR FOAM
- BREATHER MEMBRANE
- 50mm COUNTER BATTEN
- 150mm LIGHT STEEL FRAME SYSTEM WITH 120mm ECOTHERM ECO-VERSAL INSULATION IN BETWEEN
- VCL
- 15mm FIRELINE PLASTERBOARD.
- 12.5mm PLASTERBOARD
- ALL JOINTS TO BE TAPED AND SEALED

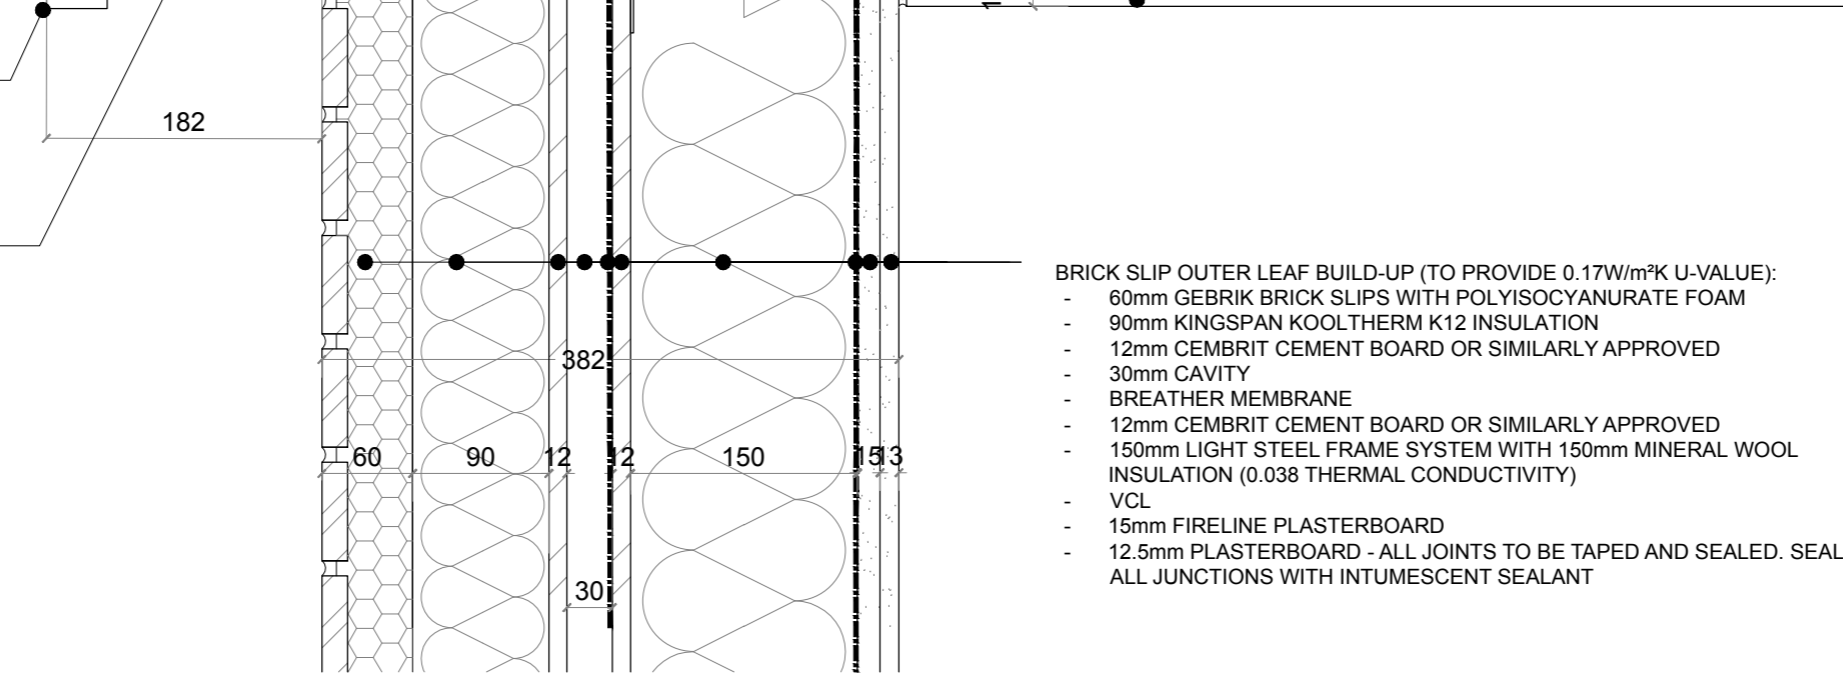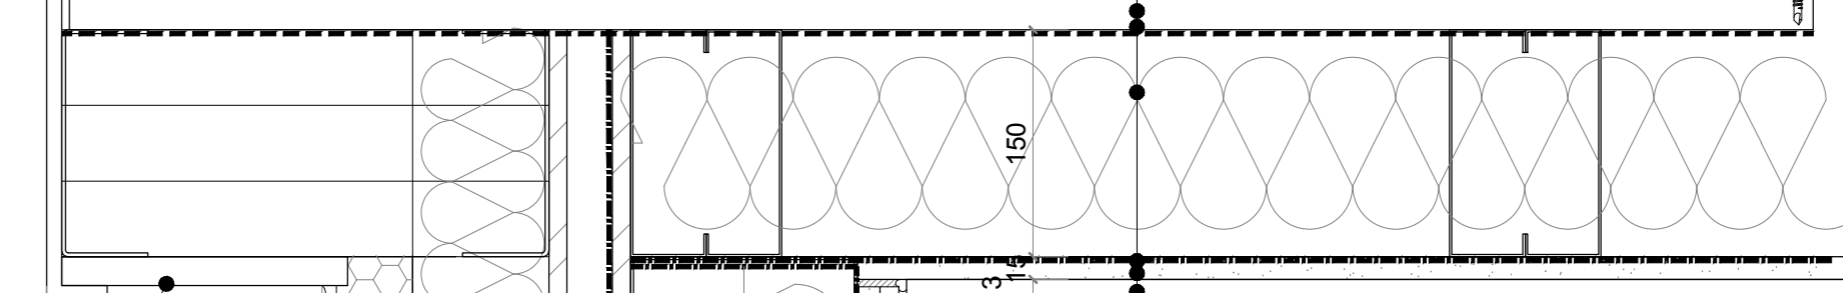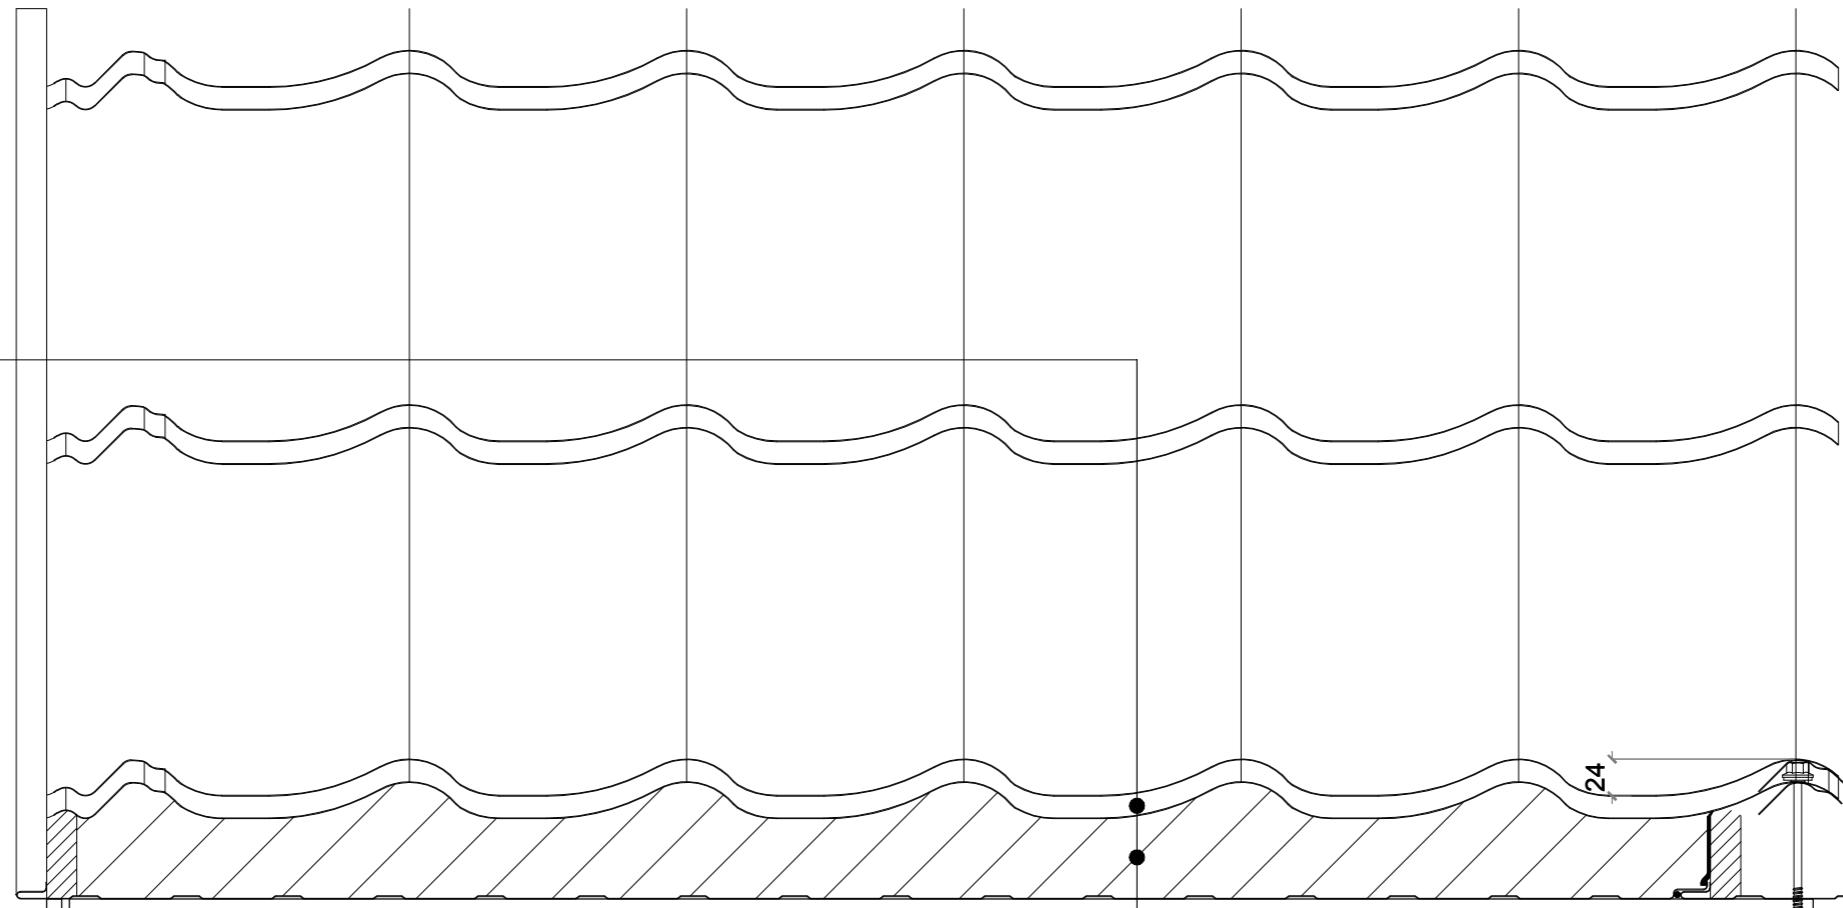

BRICK SLIP OUTER LEAF BUILD-UP (TO PROVIDE 0.17W/m²K U-VALUE):

- 60mm GEBRIK BRICK SLIPS WITH POLYISOCYANURATE FOAM
- 90mm KINGSPAN KOOL THERM K12 INSULATION
- 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
- 30mm CAVITY
- BREATHER MEMBRANE
- 12mm CEMBRIT CEMENT BOARD OR SIMILARLY APPROVED
- 150mm LIGHT STEEL FRAME SYSTEM WITH 150mm MINERAL WOOL INSULATION (0.038 THERMAL CONDUCTIVITY)
- VCL
- 15mm FIRELINE PLASTERBOARD
- 12.5mm PLASTERBOARD - ALL JOINTS TO BE TAPED AND SEALED. SEAL ALL JUNCTIONS WITH INTUMESCENT SEALANT

PVC FASCIA BOARD

182

PROPRIETARY 19mm SOFFIT BOARD

Rev.	Date	Description	Init.
------	------	-------------	-------

Client

HADFRAME

Project Title

HADFRAME SYSTEM

Drawing Title

3B5P

VERGE DETAIL - COMPOSITE PANEL TILE
INSULATED BRICK SLIP

Cad File	Sheet Size	Scale
----------	------------	-------

1485_DETAILS SET A3	A3	1:5
---------------------	----	-----

Drawn by	Drawing Date	Approved by
----------	--------------	-------------

AM	NOV 2016	DW
----	----------	----

Project No.	Drawing No.	Revision
-------------	-------------	----------

1485	D06A-43	—
------	---------	---